


Hitachi RAI Cassettes (RAR-3U1 I/R Controller)

4°C Temperature Differential Removal

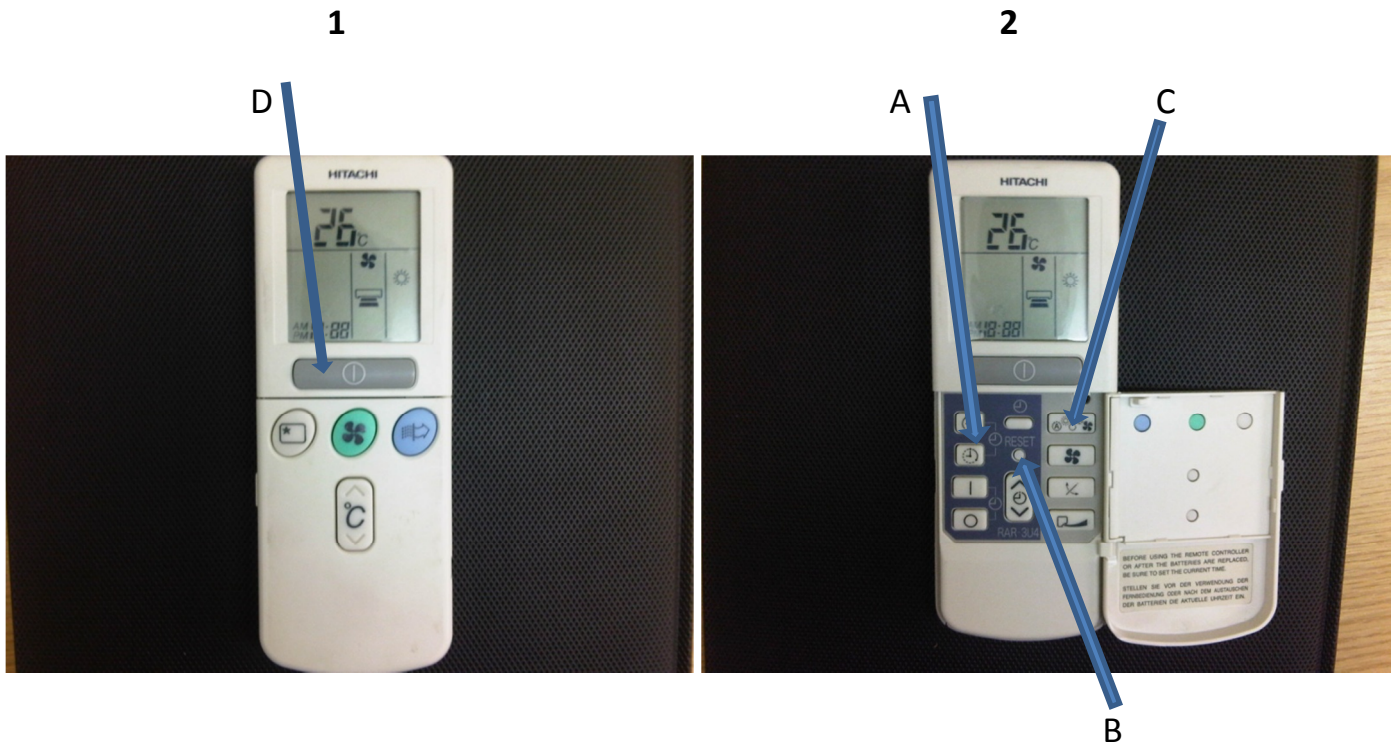

- Step 1 - Whilst controller is on, as above in Picture 1. Open flap, press and hold down button A whilst depressing the small reset button B using a pointed instrument.
- Step 2 - Press mode button C, 4 times until the fan is displayed in the bottom right hand corner.
- Step 3 - Close Flap, Press Grey on/off button D. Press °C down button until display shows ↓3.
- Step 4 - Press the green fan button, until full fan speed is selected (4 black bars under unit display).
- Step 5 - Press °C up button four times until display shows 0, Open flap press mode button. You are now back to normal use.