


Technical Bulletin

Number	074
Subject	Mitsubishi ecodan – underfloor only applications
Date	08 May 2013

FTC 2PCB Set-Up.

The ecodan Flow Temperature Controller PCB comes supplied and is for controlling the ecodan with the space heating requirement. This document showcases an installed example and details what comes with the ecodan package as well as how the system was set for this application. *Please check installation manual first.*

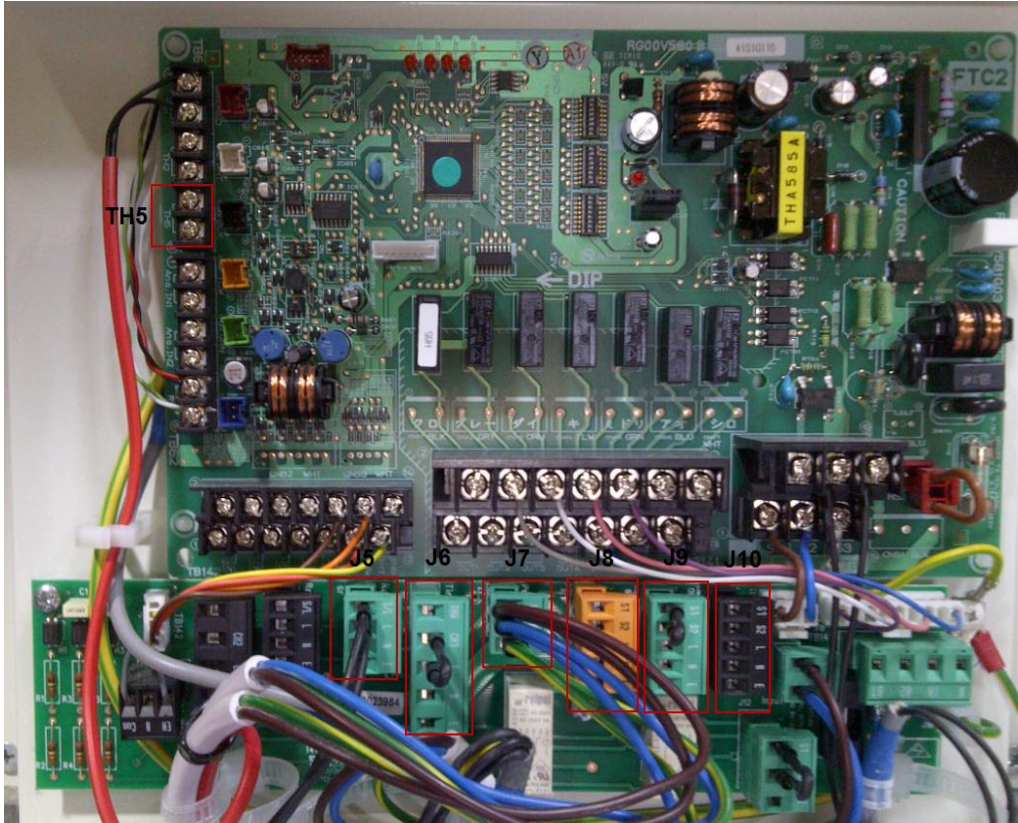

TH5	TH5 -Leave disconnected					
J12	Link Pins J1&J2 on J12	Use Pins 1&2 on J5 to connect to VFC on Underfloor Controls				
J3	J3 - Leave disconnected		J5	J6	J8	J9
			Link Pins 2&3 on J6	J9 – leave disconnected	Link Pins 1&2 on J9	J10 – leave disconnected
						J14 – leave disconnected

Other items supplied with Package

