


Technical Bulletin

Number	058
Subject	Mitsubishi Mr Slim Wiring Option
Date	Friday, 03 December 2010

Mitsubishi Mr Slim systems are typically wiring to the Condensing Unit with the Live, Neutral and Comms feeding the indoor unit on S1, S2 and S3 respectively.

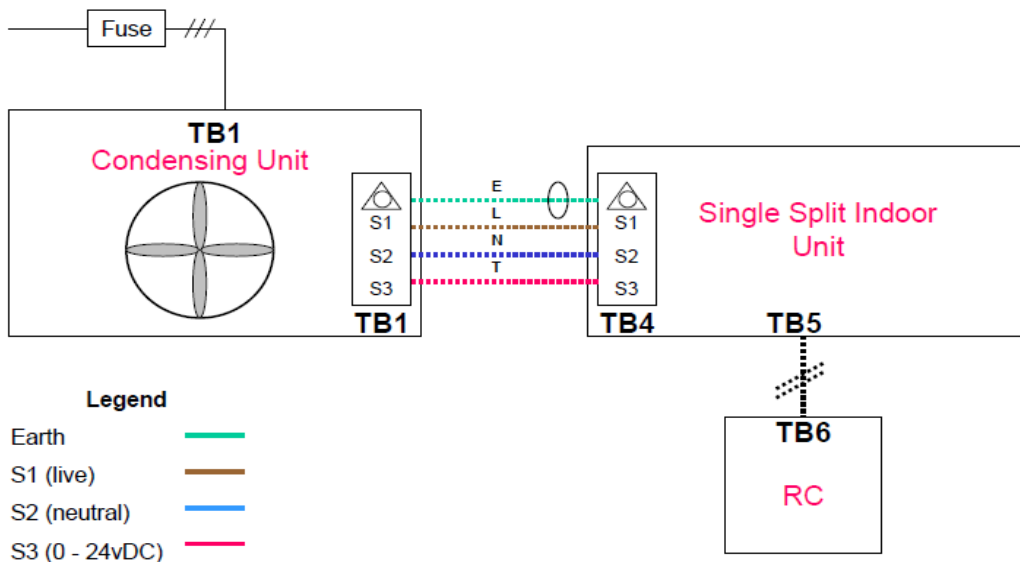

As an alternative, a separate terminal block can be purchased to allow you to provide a separate 240vAC supply to the indoor unit. This plugs into **CN01** on the Indoor PCB.

System Model and Type	Terminal Block Part No.
PLA Cassette	PAC-SH52HR-E
PKA Wall	PAC-SG94HR-E
PCA Standard Under Ceiling	PAC-SG96HR-E
PSA Floor	PAC-SG96HR-E
PEAD Ducted	PAC-SG97HR-E
PCA S/Steel Under Ceiling	PAC-SG97HR-E

