







7.1 Dimensions

7.1.1 RCI-(1.0-6.0)FSR - 4 way cassette

◆ RCI-(1.0-2.5)FSR with panel P-N23NA2 / P-AP160KA3

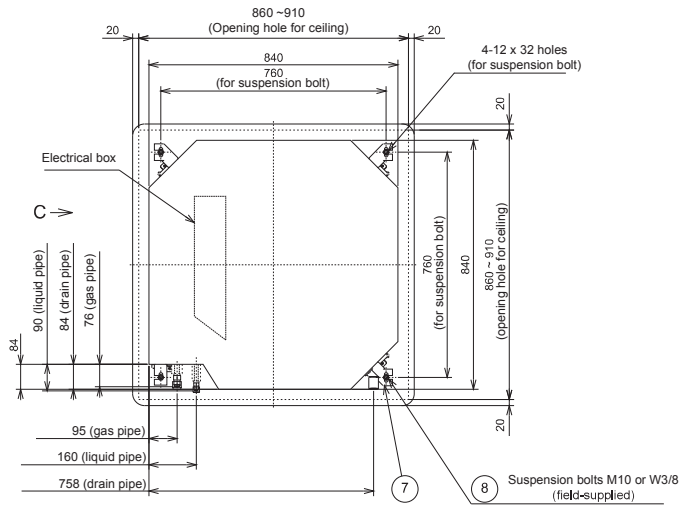

Lifting drain piping

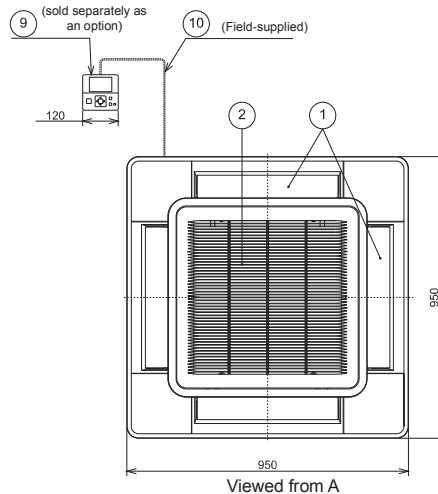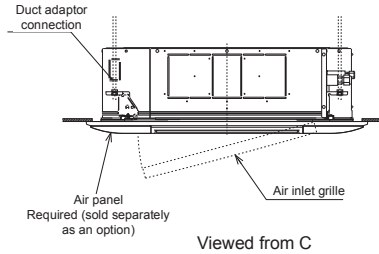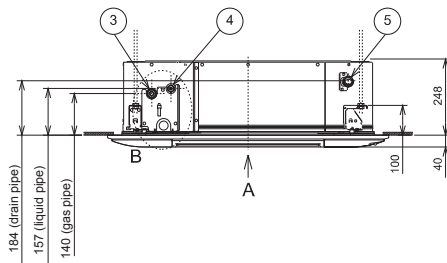



N°	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut, (1.0/1.5/2.0): ϕ 12.7, (2.5): ϕ 15.88
4	Refrigerant connection (liquid)	Flare nut, (1.0/1.5/2.0): ϕ 6.35, (2.5): ϕ 9.52
5	Drain connection	ϕ 32 (VP25)
6	Wiring hole	Die cut hole ϕ 30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

i NOTE





- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.

Dimensions

◆ RCI-(3.0-6.0)FSR with panel P-N23NA2 / P-AP160KA3

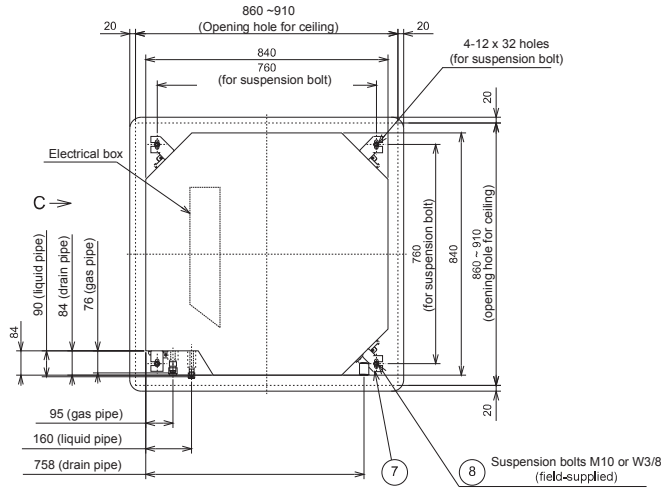

Lifting drain piping

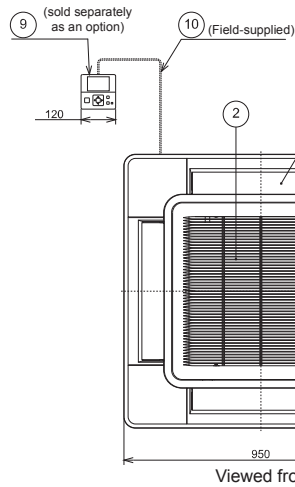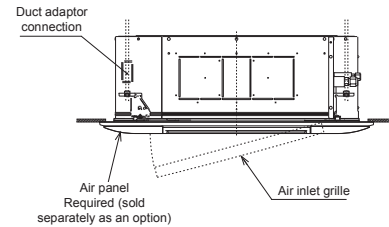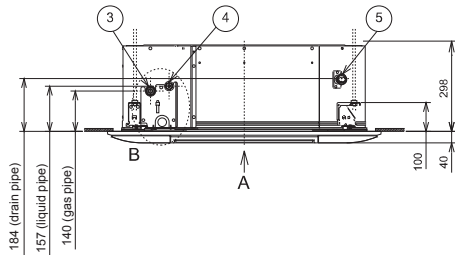


N°	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut. ϕ 15,88
4	Refrigerant connection (liquid)	Flare nut. ϕ 9,52
5	Drain connection	ϕ 32 (VP25)
6	Wiring hole	Die cut hole. ϕ 30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

i NOTE

- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.



◆ RCI-(1.0-2.5)FSR with panel P-GP160NAP / P-GP160NAPU / P-GP160KAP

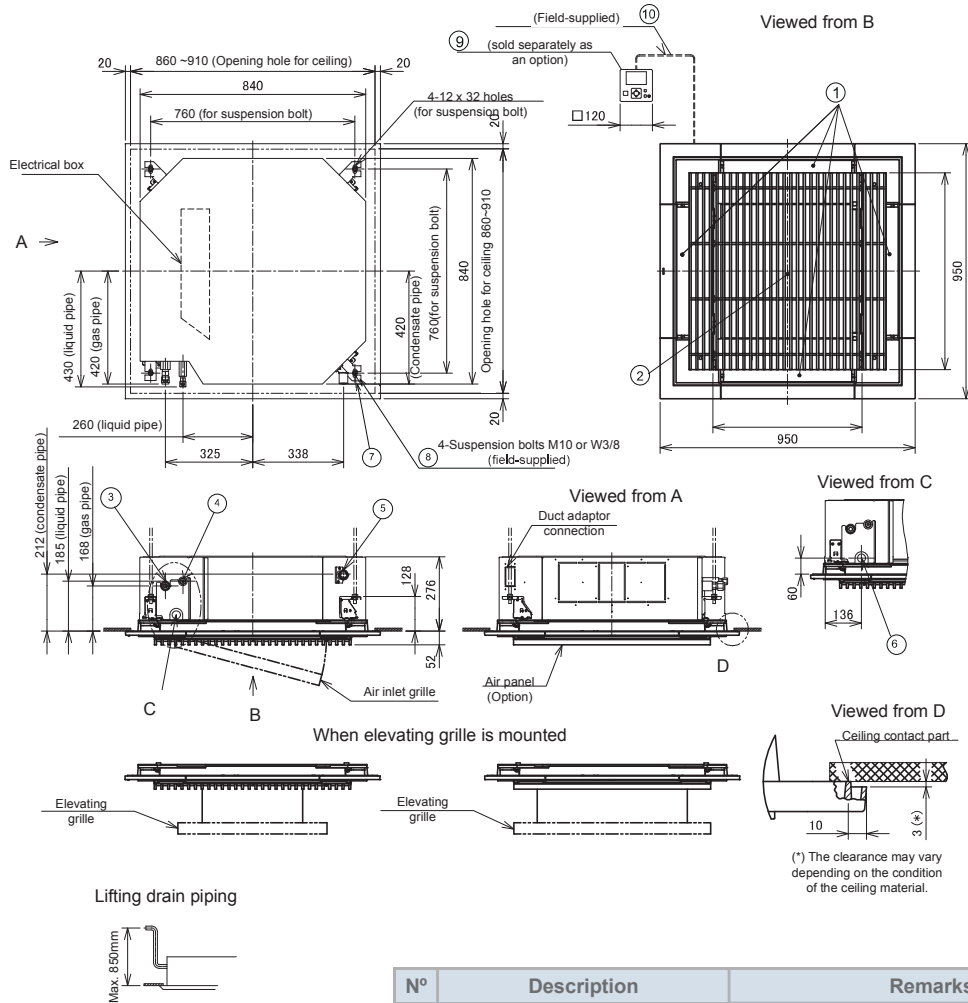


N°	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut, (1.0/1.5/2.0): ϕ 12.7, (2.5): ϕ 15.88
4	Refrigerant connection (liquid)	Flare nut, (1.0/1.5/2.0): ϕ 6.35, (2.5): ϕ 9.52
5	Drain connection	ϕ 32 (VP25)
6	Wiring hole	Die cut hole ϕ 30
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

i NOTE

- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.

◆ RCI-(3.0-6.0)FSR with panel P-GP160NAP / P-GP160NAPU / P-GP160KAP

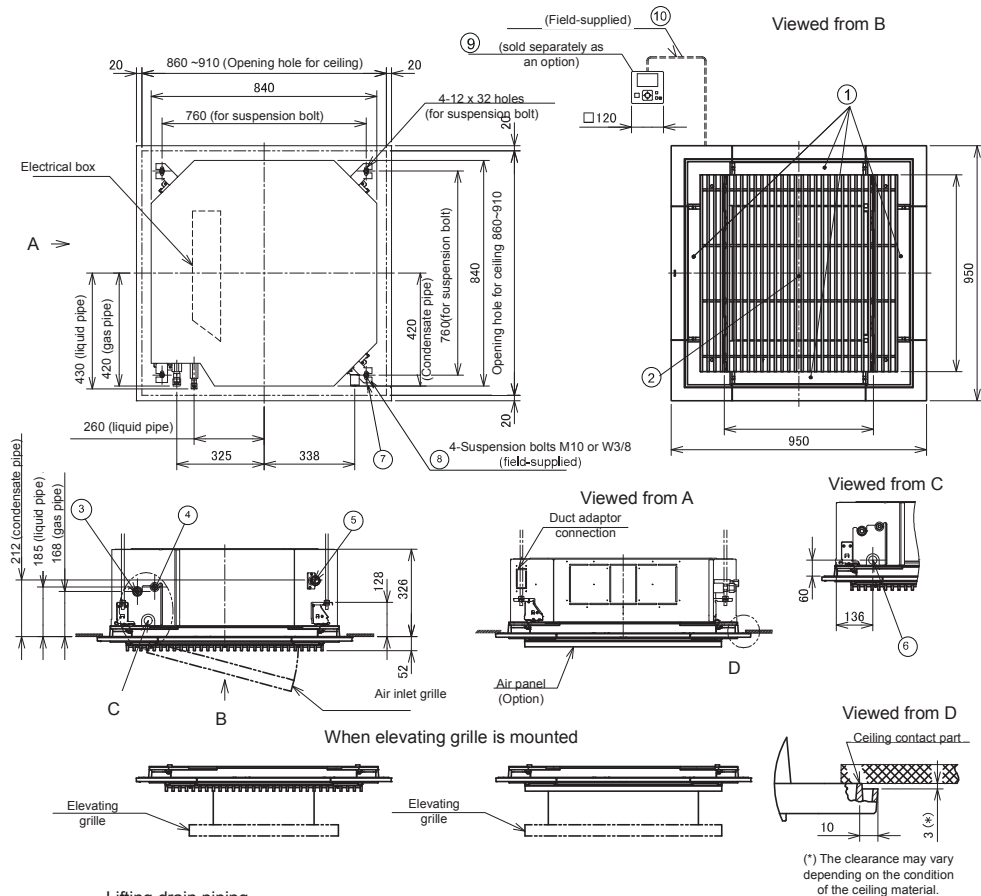

(*) The clearance may vary depending on the condition of the ceiling material.

N°	Description	Remarks
1	Air outlet	4-way
2	Air inlet	
3	Refrigerant connection (gas)	Flare nut. $\phi 15.88$
4	Refrigerant connection (liquid)	Flare nut. $\phi 9.52$
5	Drain connection	$\phi 32$ (VP25)
6	Wiring hole	Die cut hole. $\phi 30$
7	Unit suspension bracket	(4x) M10 or W3/8
8	Unit suspension bolt	(4x) M10 or W3/8
9	Remote Control Switch	Sold separately as an option (recommended PC-ARFP1E)
10	Shielded Twist-Pair Cable	For Remote Control Switch

i NOTE

- Distance between the wall and panel edge must be min. 1500mm to prevent short circuiting of the air flow.
- All measurements are in mm.

