


◆ KPI-(502-802)(E/H)2E - Energy / heat recovery unit

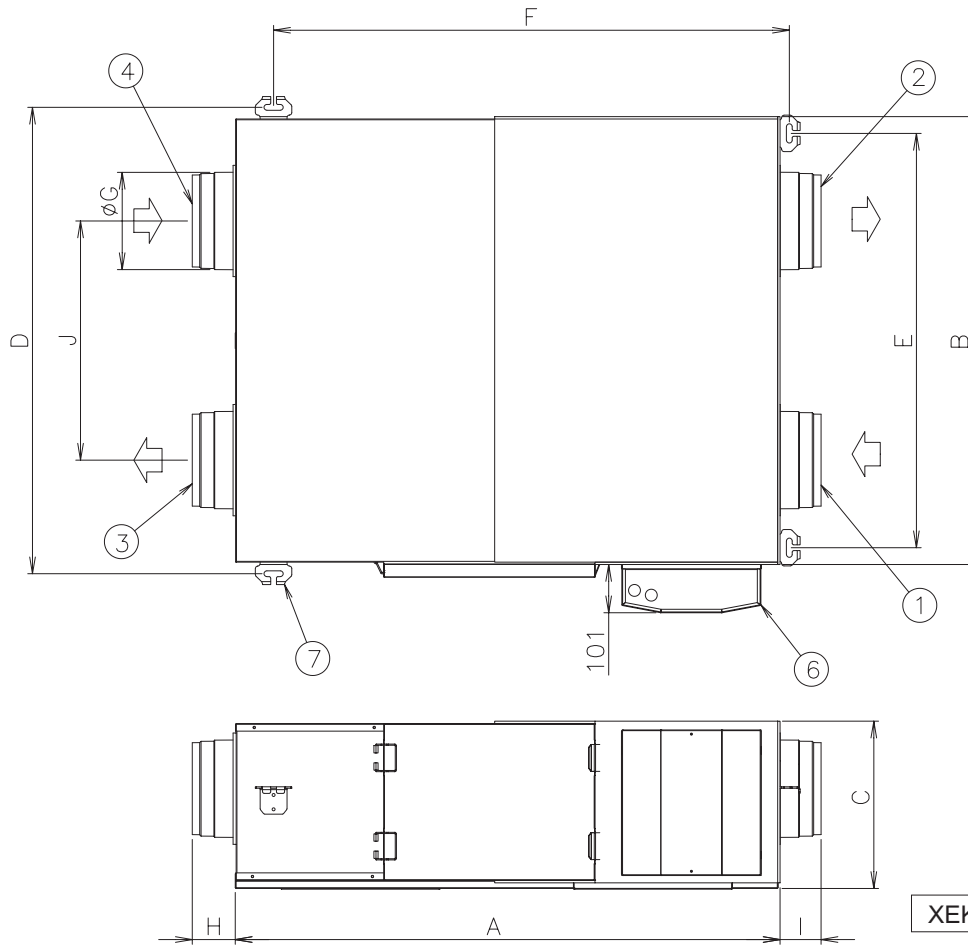


No.	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)

Models	A	B	C	D	E	F	G	H	I	J
KPI-502(E/H)3E	1136	934	249	972	864	1075	200	90	86	499
KPI-802(E/H)3E	1213	1024	405	1066	954	1165	250	90	86	589

All measurements are in mm.

◆ KPI-(1002-2002)(E/H)2E - Energy / heat recovery unit

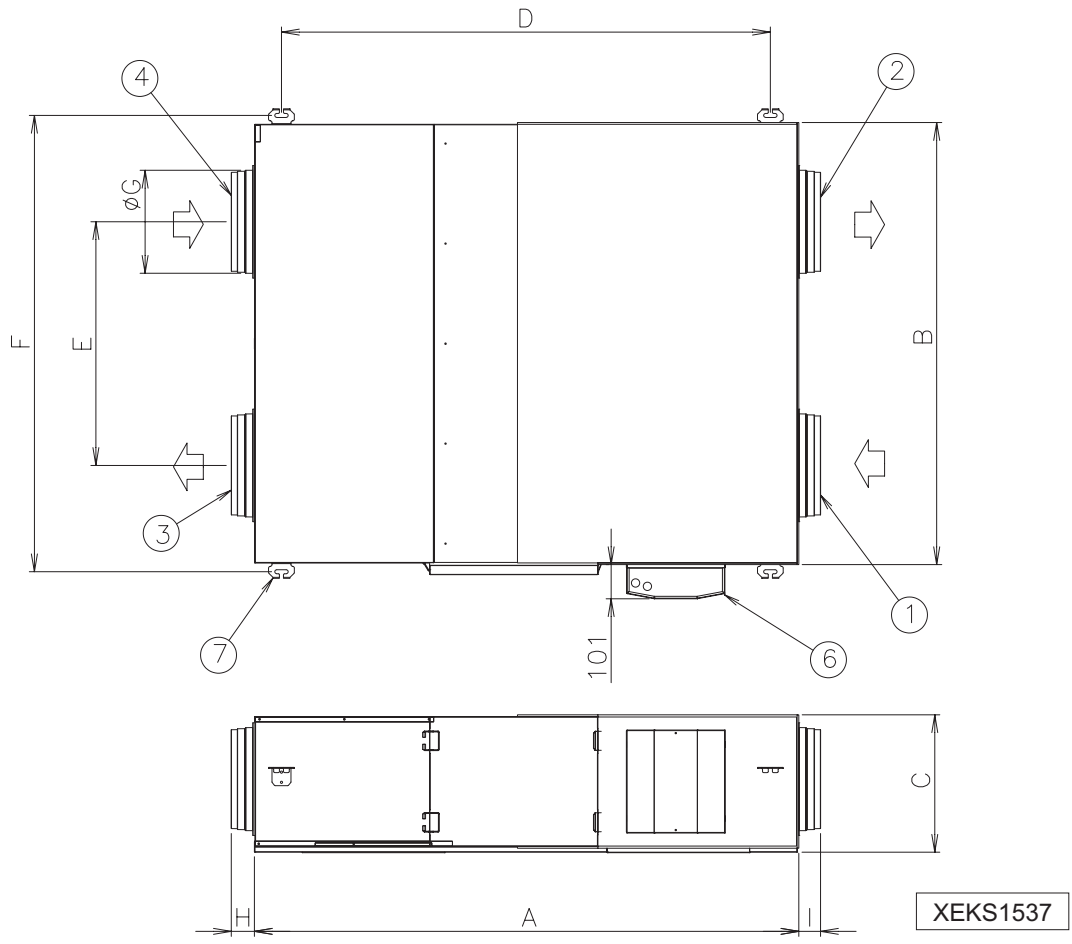

No.	Description	Remarks
1	Outdoor air	Fresh air inlet from outdoors
2	Exhaust air	Exhaust air outlet to outdoors
3	Air supply	Fresh air to the room
4	Return air	Exhaust air from the room
6	Electrical box	
7	Unit suspension bracket	(4x)

Models	A	B	C	D	E	F	G	H	I
KPI-1002(E/H)3E	1606	1304	405	1442	719	1346	300	68	64
KPI-1502(E/H)3E	1806	1138	547	1622	623	1180	355	90	86
KPI-2002(E/H)3E	1806	1438	547	1622	921	1480	355	90	86

All measurements are in mm.