

3. HOW TO INSTALL THE INDOOR UNIT

■ High Static Pressure Ducted Type (E2 Type)

3-1. Required Minimum Space for Installation and Service

(1) Dimensions of suspension bolt pitch and unit

Unit: mm


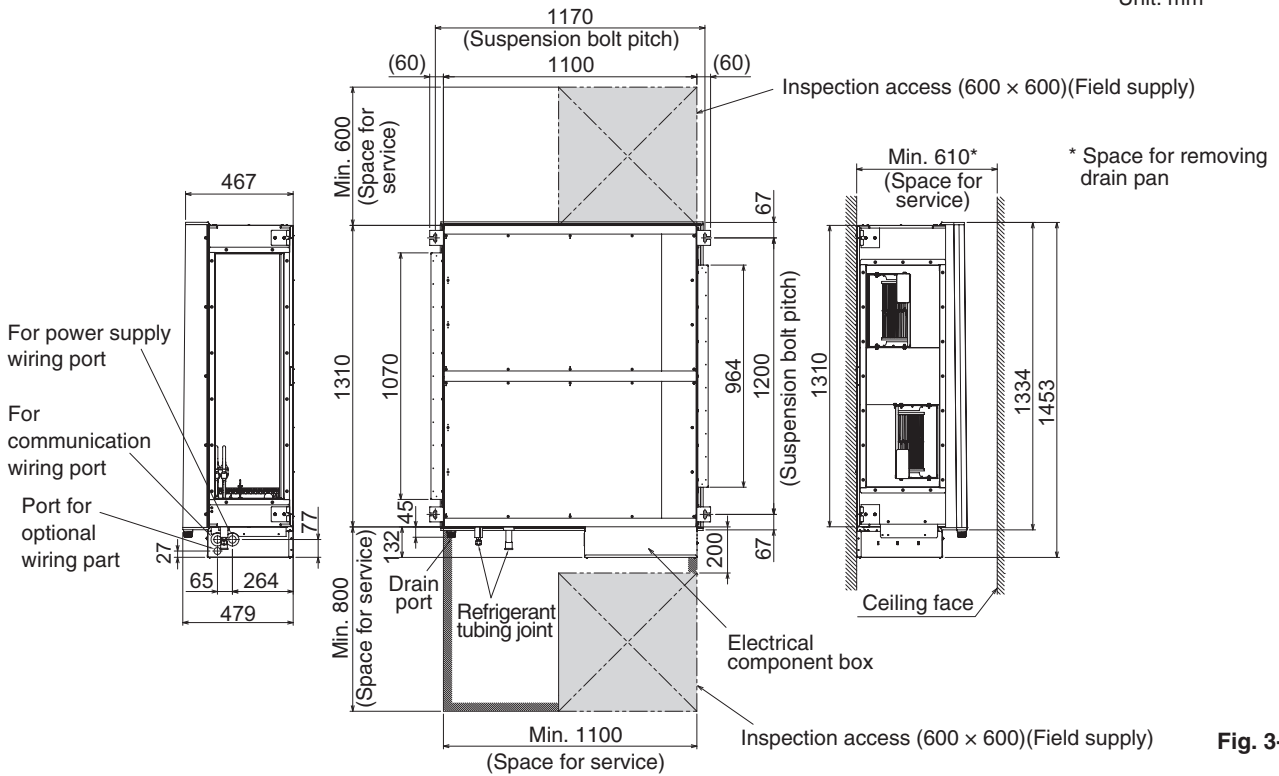


Fig. 3-1

(2) Dimensions of indoor unit

Types 224 / 280

Unit : mm

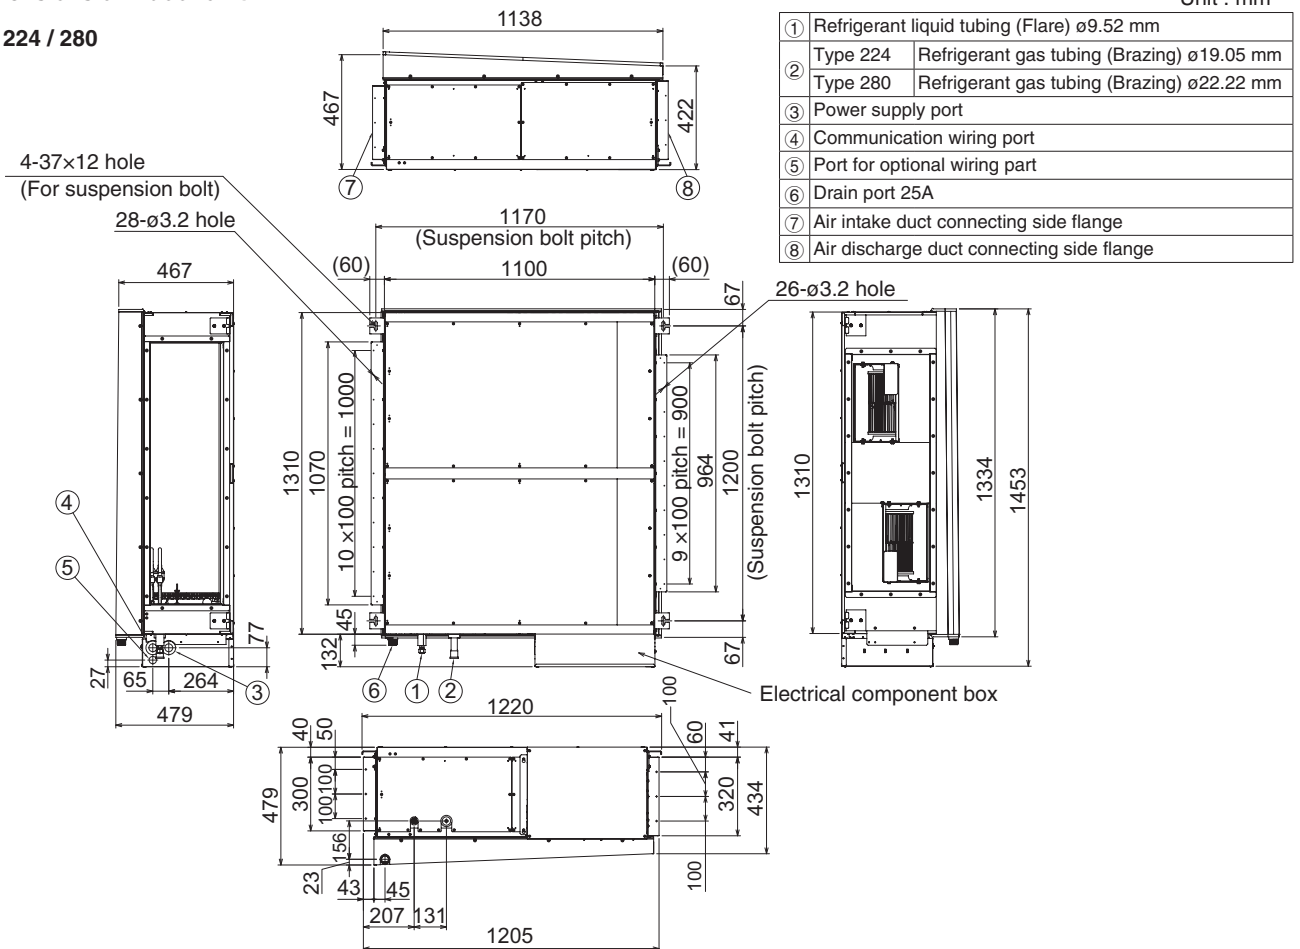

①	Refrigerant liquid tubing (Flare) ø9.52 mm
②	Type 224 Refrigerant gas tubing (Brazing) ø19.05 mm
②	Type 280 Refrigerant gas tubing (Brazing) ø22.22 mm
③	Power supply port
④	Communication wiring port
⑤	Port for optional wiring part
⑥	Drain port 25A
⑦	Air intake duct connecting side flange
⑧	Air discharge duct connecting side flange

Fig. 3-2