



1-2. Dimensional Data

(A) Indoor Units: S-36PY2E5B, S-45PY2E5B, S-50PY2E5B

unit: mm

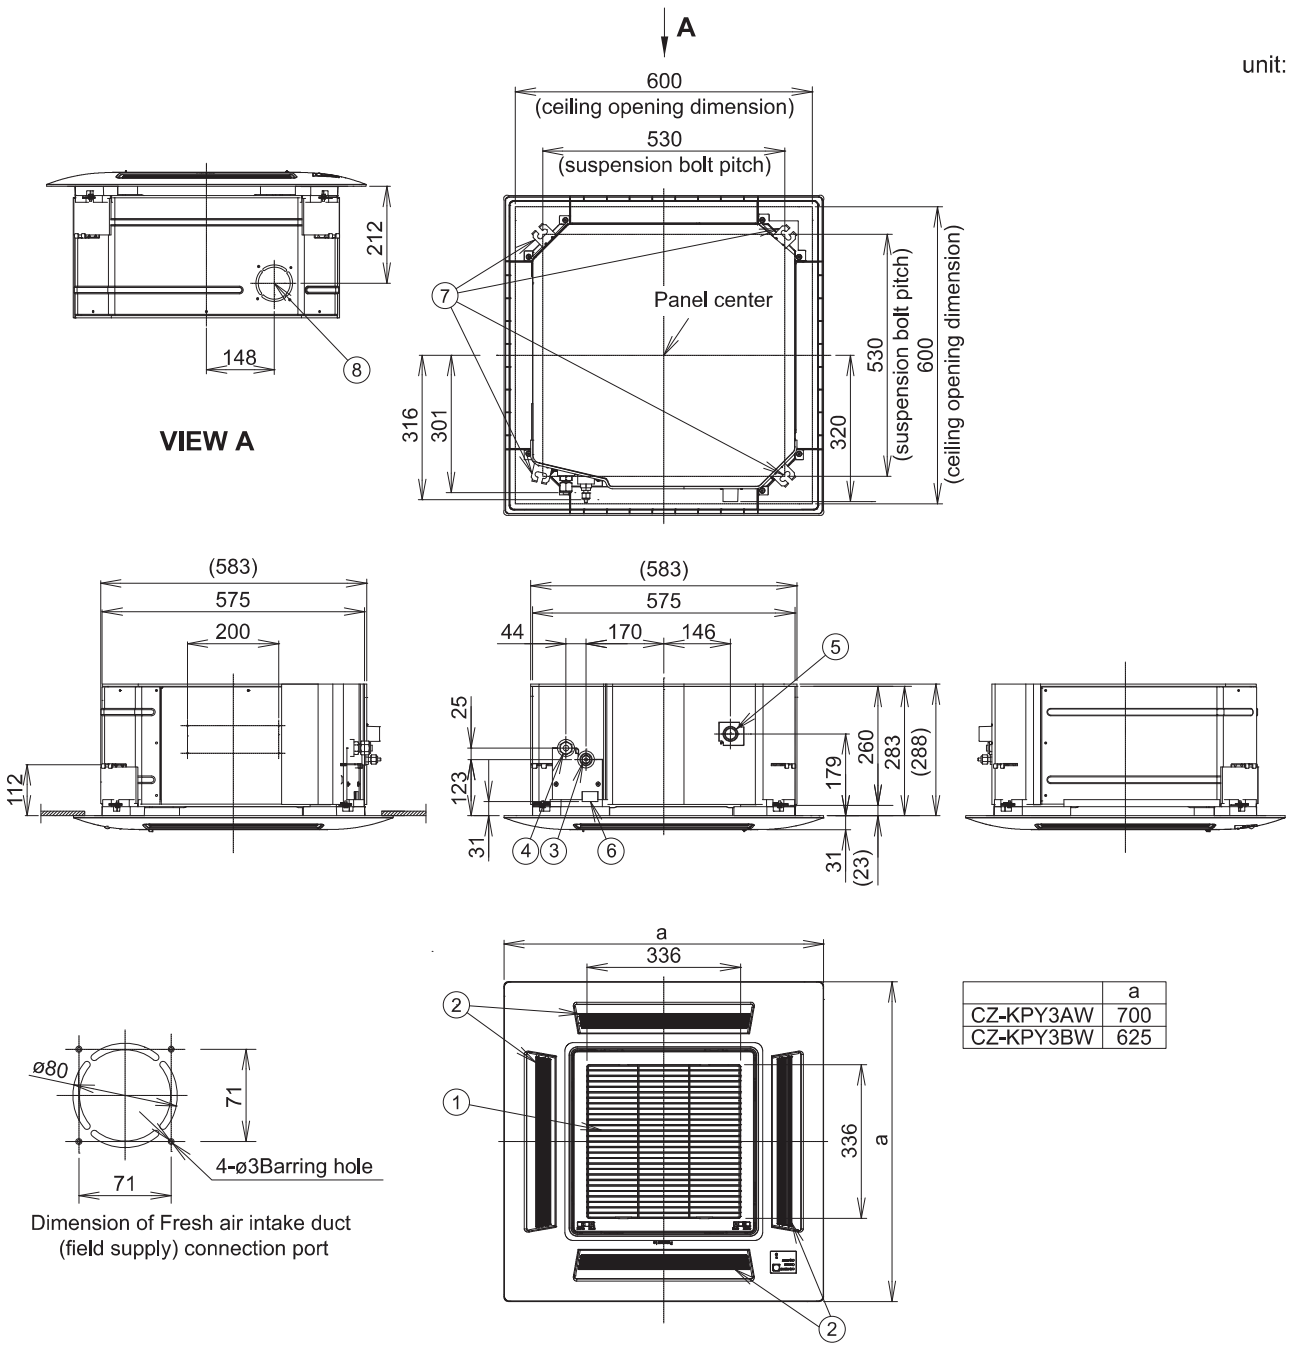

①	Air intake grille
②	Air outlet
③	Refrigerant piping (liquid pipe) $\phi 6.35$ (flared)
④	Refrigerant piping (gas pipe) $\phi 12.7$ (flared)
⑤	Drain tube connection port VP25 (outer $\phi 32$)
⑥	Power supply entry
⑦	Suspension bolt hole (4-11 x 26 slot)
⑧	Fresh air intake duct connection port ($\phi 80$)



Adjust the suspension bolt length so that the gap from the lower ceiling surface becomes 45mm or more, as shown in the figure at right. If the suspension bolts is too long, it will contact the ceiling panel and the unit cannot be installed.