




**SEZ-M25DA(L)**  
**SEZ-M35DA(L)**  
**SEZ-M50DA(L)**  
**SEZ-M60DA(L)**  
**SEZ-M71DA(L)**


Secure enough access space to allow for the maintenance, inspection, and replacement of the motor, fan, drain pump, heat exchanger, and electric box in one of the following ways.  
 Select an installation site for the indoor unit so that its maintenance access space will not be obstructed by beams or other objects.

- (1) When a space of 300 mm or more is available below the unit between the unit and the ceiling (Fig. 1)
  - Create access door 1 and 2 (450 x 450 mm each) as shown in Fig. 2.  
 (Access door 2 is not required if enough space is available below the unit for a maintenance worker to work in).
- (2) When a space of less than 300 mm is available below the unit between the unit and the ceiling (At least 20 mm of space should be left below the unit as shown in Fig. 3.)
  - Create access door 1 diagonally below the electric box and access door 3 below the unit as shown in Fig. 4.
  - or
  - Create access door 4 below the electric box and the unit as shown in Fig. 5.


**Unit : mm**

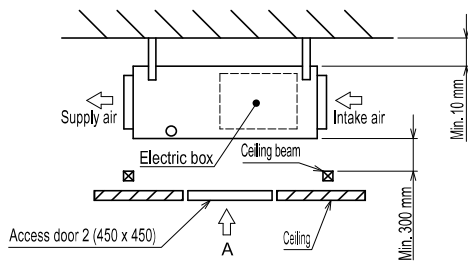


**Fig. 1**

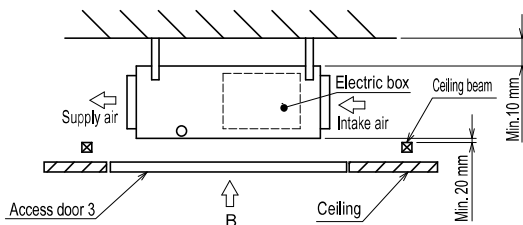


**Fig. 3**

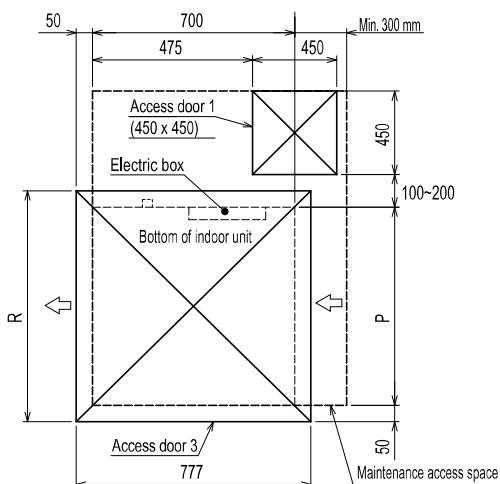

**Fig. 4** (Viewed from the direction of the arrow B)

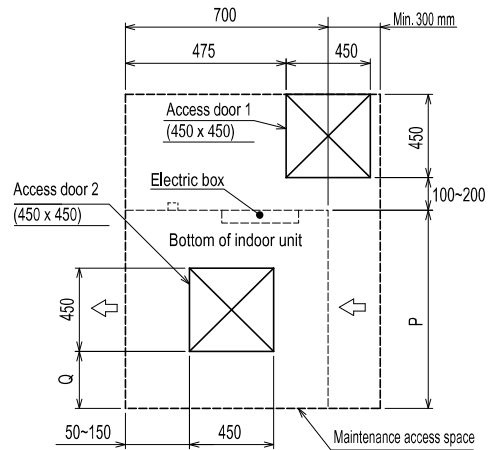

**Fig. 2** (Viewed from the direction of the arrow A)

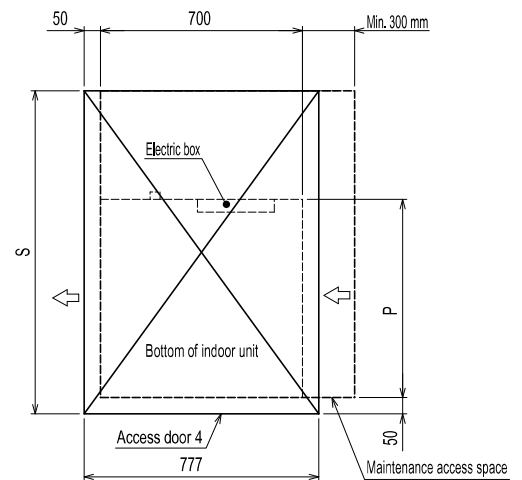

**Fig. 5** (Viewed from the direction of the arrow B)

	(mm)			
Model	P	Q	R	S
SEZ-M25	700	50~150	800	1300
SEZ-M35, 50	900	150~250	1000	1500
SEZ-M60, 71	1100	250~350	1200	1700