


	Panasonic 9-16kW
1	Panasonic H & J Series
2	32 Amp Isolator IMO
3	1" F swivel x 1" M extended lever ball isolating valve x 2
4	750mm long 1" swivel bent female x 28mm copper insulated hoses (pair)
5	Single 600mm Standard Rubber Mount & M10 x 40 stud nuts x 2 Sets
6	28mm Magnetic Filter
7	28mm Flow Balancing Valve with fill & flush Ports
8	15mm Filling Loop with gauge WRAS approved
9	1" Female three way diverting valve 230v
10	50 Litre Buffer Vessel (Rated ERP B)
10A	1/2" Male Automatic Air Vent
10B	1/2" Male Drain Cock
11	1" Male x 28mm iron to copper adaptors (Three port valve & ASHP) x 5
12	1" Male x 28mm iron to copper adaptors (Cylinder Coil) x 2
13	Duca APE25-8-130 230V/1ph/50Hz Heating circulating pump
14	28mm x 1.1/2" Pump ball isolating valve x 2
15	Electric Generation Meter (MCS Requirement)
16	Thermoblend Glycol 25 litre Drum
17	Panasonic Sensor for third party cylinder

**Panasonic 9-16kW**

AQUAREA

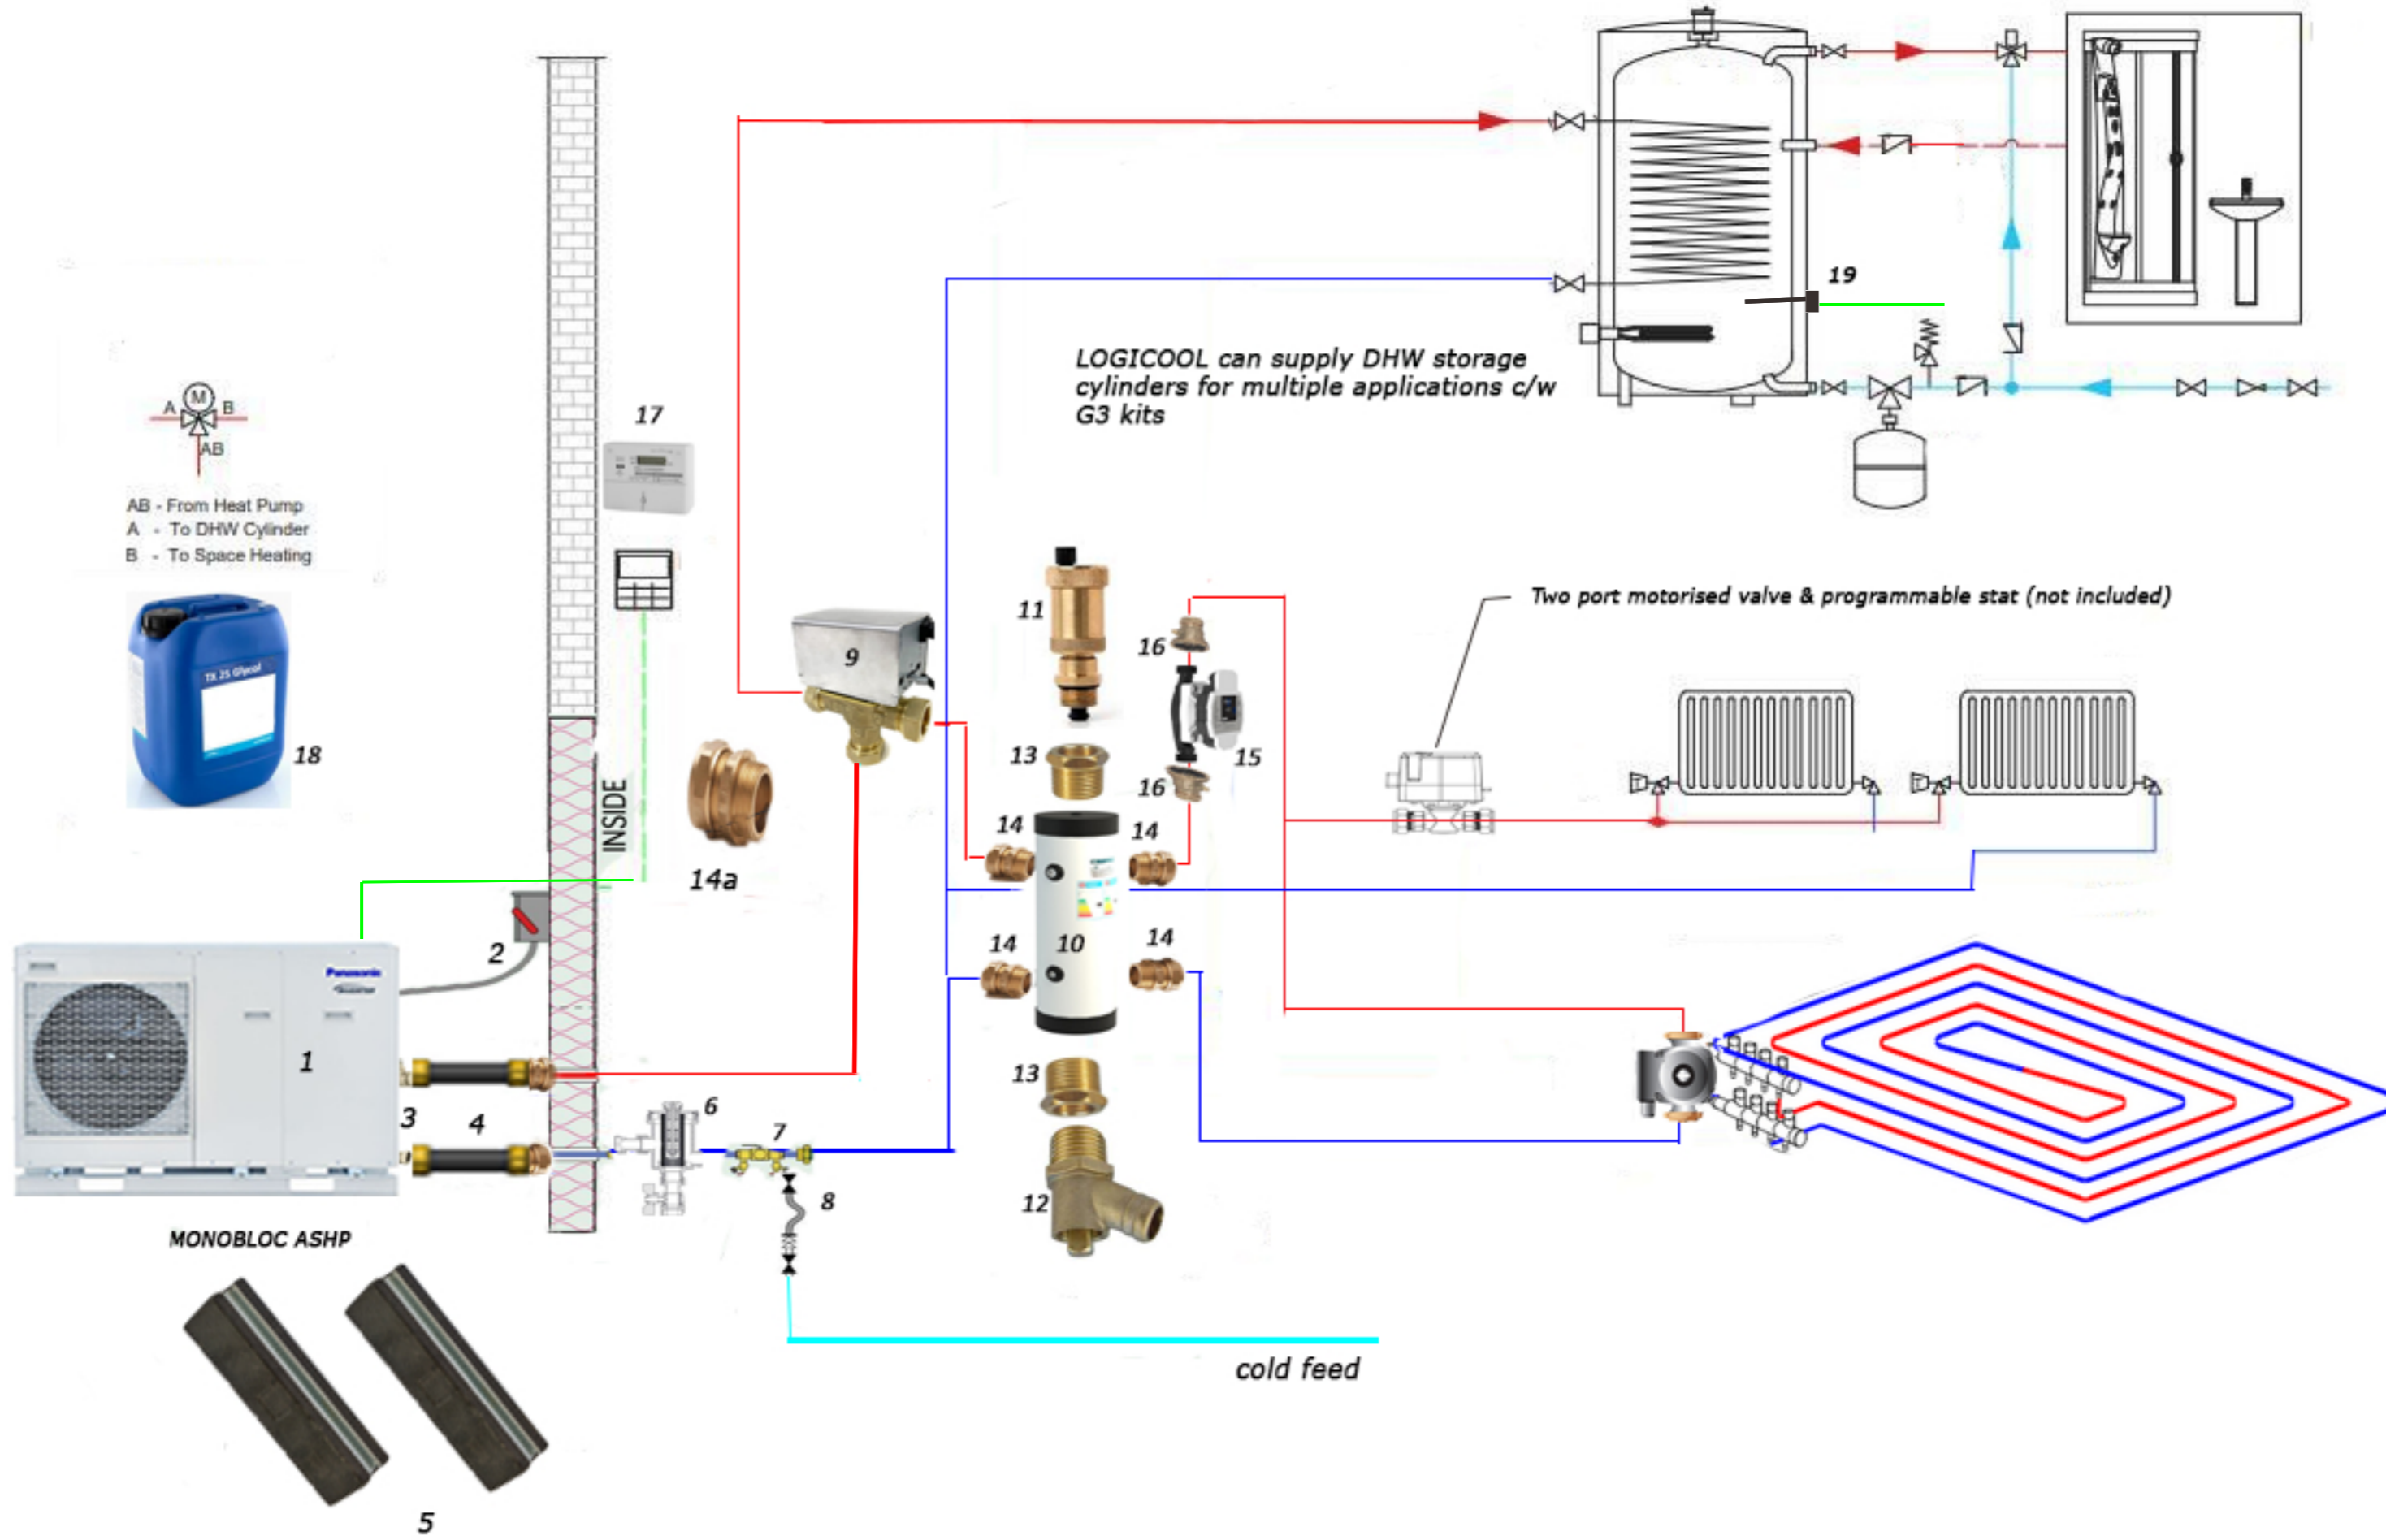

Panasonic 5-7kW	
1	Panasonic H & J Series
2	32 Amp Isolator IMO
3	1" F swivel x 1" M extended lever ball isolating valve <b>x 2</b>
4	750mm long 1" swivel bent female x 28mm copper insulated hoses (pair)
5	Single 600mm Standard Rubber Mount & M10 x 40 stud nuts <b>x 2 Sets</b>
6	28mm Magnetic Filter
7	28mm Flow Balancing Valve with fill & flush Ports
8	15mm Filling Loop with gauge WRAS approved
9	1" Female three way diverting valve 230v
10	25 Litre Buffer Vessel 4 x 1" & 2 x 3/4" Female connections (Rated ERP B)
11	1/2" Male Automatic Air Vent
12	1/2" Male Drain Cock
13	3/4" x 1/2" Reducing Brass Bush <b>x 2</b>
14	1" Male x 28mm iron to copper adaptors (Buffer Vessel) <b>x 4</b>
14A	1" Male x 28mm iron to copper adaptors (Three port valve & ASHPI) <b>x 5</b>
15	Duca APE25-8-130 230V/1ph/50Hz Heating circulating pump
16	28mm x 1.1/2" Pump ball isolating valve <b>x 2</b>
17	Electric Generation Meter (MCS Requirement)
18	Thermoblend Glycol 25 litre Drum
19	Panasonic Sensor for third party cylinder

**Panasonic**  
 AQUAREA