


[1] Outlines & Dimensions

INDOOR UNIT

PEA-M200, 250LA

Unit: mm

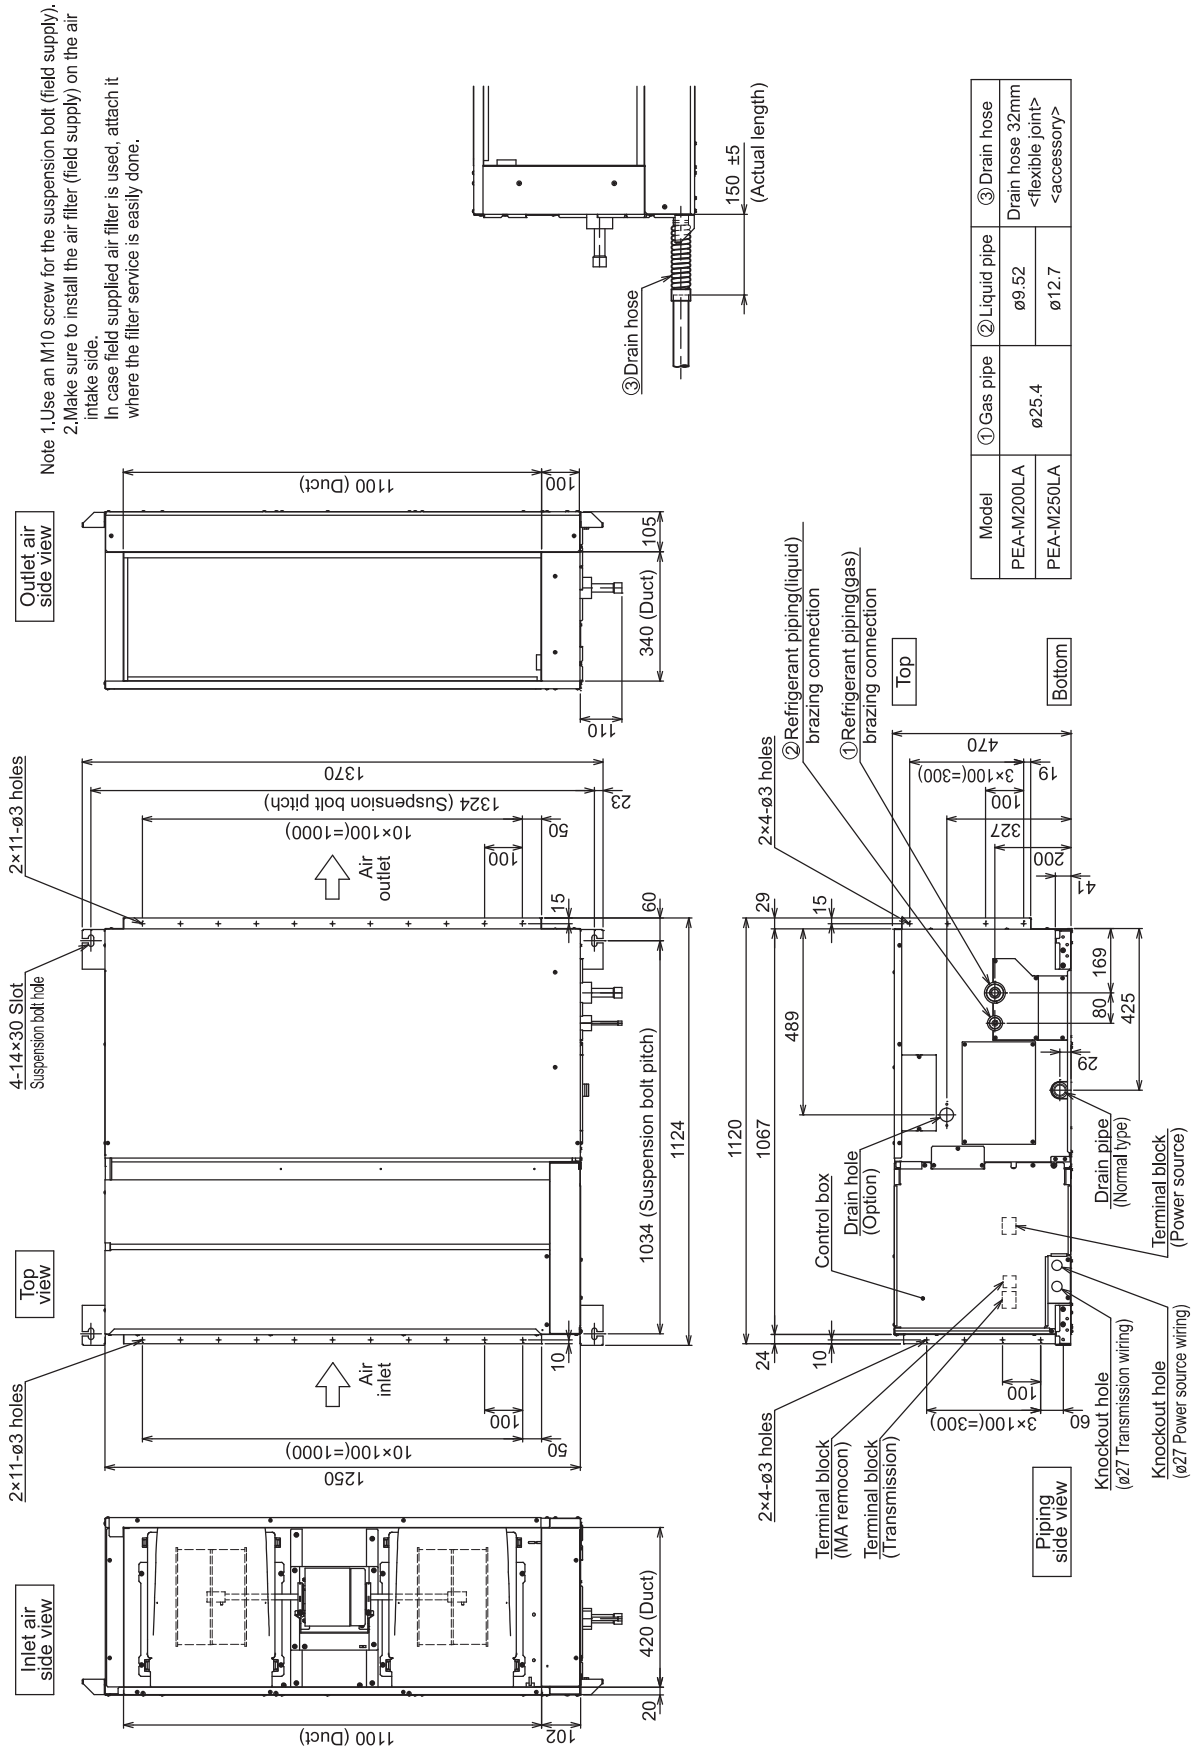

Note 1. Use an M10 screw for the suspension bolt (field supply).
 2. Make sure to install the air filter (field supply) on the air intake side.
 In case field supplied air filter is used, attach it where the filter service is easily done.

Model	① Gas pipe	② Liquid pipe	③ Drain hose
PEA-M200LA	ø25.4	ø9.52	Drain hose 32mm <flexible joint>
PEA-M250LA	ø25.4	ø12.7	<accessory>