


TECHNICAL & SERVICE MANUAL

Models

PEFY-MS40VMHS-A
PEFY-MS50VMHS-A
PEFY-MS63VMHS-A
PEFY-MS71VMHS-A

PEFY-MS80VMHS-A
PEFY-MS100VMHS-A
PEFY-MS125VMHS-A
PEFY-MS140VMHS-A

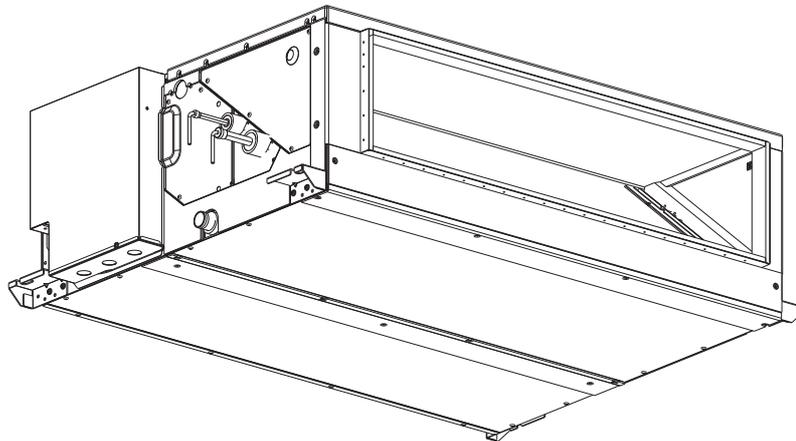

CITY MULTI

Safety Precautions

Read before installation and performing electrical work

- Thoroughly read the following safety precautions prior to installation.
- Observe these safety precautions for your safety.
- This equipment may have adverse effects on the equipment on the same power supply system.
- Contact the local power authority before connecting to the system.

MEANINGS OF SYMBOLS DISPLAYED ON THE UNIT

	WARNING (Risk of fire)	This symbol is only for R32 refrigerant. The type of the refrigerant used is written on the nameplate on the outdoor unit. R32 refrigerant is flammable. If the refrigerant leaks, or comes in contact with fire or parts that generate heat, it may create harmful gas and pose a risk of fire.
	Read the OPERATION MANUAL carefully before operation.	
	Service personnel are required to carefully read the OPERATION MANUAL and INSTALLATION MANUAL before operation.	
	Further information is available in the OPERATION MANUAL, INSTALLATION MANUAL, and the like.	

Symbols used in the text



WARNING

Describes precautions that should be observed to prevent danger of injury or death to the user.



CAUTION

Describes precautions that should be observed to prevent damage to the unit.

Symbols used in the illustrations



Indicates an action that must be avoided.



Indicates that important instructions must be followed.



Indicates a part which must be grounded.



Indicates that caution should be taken with rotating parts. (This symbol is displayed on the main unit label.) <Color: yellow>



Beware of electric shock (This symbol is displayed on the main unit label.) <Color: yellow>



WARNING

Carefully read the labels affixed to the main unit.



WARNING

- **Ask the dealer or an authorized technician to install the air conditioner.**
 - Improper installation by the user may result in water leakage, electric shock, or fire.
- **Install the air unit at a place that can withstand its weight.**
 - Inadequate strength may cause the unit to fall down, resulting in injuries.
- **For indoor units not accessible to the general public, install them more than 2.5 m above the floor or ground level.**
- **This unit should be installed in rooms which exceed the floor space specified in outdoor unit installation manual.**
Refer to outdoor unit installation manual.
- **Use the specified cables for wiring. Make the connections securely so that the outside force of the cable is not applied to the terminals.**
 - Inadequate connection and fastening may generate heat and cause a fire.
- **Prepare for typhoons and other strong winds and earthquakes and install the unit at the specified place.**
 - Improper installation may cause the unit to topple and result in injury.
- **Always use an air cleaner, humidifier, electric heater, and other accessories specified by Mitsubishi Electric.**
 - Ask an authorized technician to install the accessories. Improper installation by the user may result in water leakage, electric shock, or fire.
- **Never repair the unit. If the air conditioner must be repaired, consult the dealer.**
 - If the unit is repaired improperly, water leakage, electric shock, or fire may result.

•Do not touch the heat exchanger fins.

- Improper handling may result in injury.

•When handling this product, always wear protective equipment.

EG: Gloves, full arm protection namely boiler suit, and safety glasses.

- Improper handling may result in injury.

•If refrigerant gas leaks during installation work, ventilate the room.

- If the refrigerant gas comes into contact with a flame, poisonous gases will be released.

•Install the air conditioner according to this Installation Manual.

- If the unit is installed improperly, water leakage, electric shock, or fire may result.

•Have all electric work done by a licensed electrician according to “Electric Facility Engineering Standard” and “Interior Wire Regulations” and the instructions given in this manual and always use a special circuit.

- If the power source capacity is inadequate or electric work is performed improperly, electric shock and fire may result.

•Keep the electric parts away from water (washing water etc.).

- It might result in electric shock, catching fire or smoke.

•Securely install the outdoor unit terminal cover (panel).

- If the terminal cover (panel) is not installed properly, dust or water may enter the outdoor unit and fire or electric shock may result.

•This unit is equipped with a leak detection system for safety. To enable the leak detection, the unit must be turned on all the time after installation, except during servicing. Aerosol spray may lead to a false detection of the refrigerant sensor.

•When using aerosol sprays for interior construction, finishing work, or sealing piping penetrations, turn off the breaker and ensure proper ventilation.

•Do not use refrigerant other than the type indicated in the manuals provided with the unit and on the nameplate.

- Doing so may cause the unit or pipes to burst, or result in explosion or fire during use, during repair, or at the time of disposal of the unit.

- It may also be in violation of applicable laws.

- MITSUBISHI ELECTRIC CORPORATION cannot be held responsible for malfunctions or accidents resulting from the use of the wrong type of refrigerant.

•Maintenance, service and repair operations shall be performed by authorized technician with required qualification.

•If the air conditioner is installed in a small room, measures must be taken to prevent the refrigerant concentration from exceeding the safety limit even if the refrigerant should leak.

- Consult the dealer regarding the appropriate measures to prevent the safety limit from being exceeded. Should the refrigerant leak and cause the safety limit to be exceeded, hazards due to lack of oxygen in the room could result.

•When moving and reinstalling the air conditioner, consult the dealer or an authorized technician.

- If the air conditioner is installed improperly, water leakage, electric shock, or fire may result.

•After completing installation work, make sure that refrigerant gas is not leaking.

- If the refrigerant gas leaks and is exposed to a fan heater, stove, oven, or other heat source, it may generate noxious gases.

•Do not reconstruct or change the settings of the protection devices.

- If the pressure switch, thermal switch, or other protection device is shorted and operated forcibly, or parts other than those specified by Mitsubishi Electric are used, fire or explosion may result.

•To dispose of this product, consult your dealer.

•Do not use a leak detection additive.

•If the supply cord is damaged, it must be replaced by the manufacturer,

- its service agent or similarly qualified persons in order to avoid a hazard.
- **This appliance is not intended for use by persons (including children) with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the appliance by a person responsible for their safety.**
- **Children should be supervised to ensure that they do not play with the appliance.**
- **The installer and system specialist shall secure safety against leakage according to local regulation or standards.**
 - The instructions in this manual may be applicable if local regulation are not available.
- **Pay a special attention to the place, such as a basement, etc. where refrigeration gas can stay, since refrigeration is heavier than the air.**
- **This appliance is intended to be used by expert or trained users in shops, in light industry and on farms, or for commercial use by lay persons.**

Precautions for devices that use R32/R410A refrigerant

CAUTION

- **Do not use the existing refrigerant piping.**
 - The old refrigerant and refrigerator oil in the existing piping contains a large amount of chlorine which may cause the refrigerator oil of the new unit to deteriorate.
- **Use refrigerant piping made of C1220 (Cu-DHP) phosphorus deoxidized copper as specified in the JIS H3300 "Copper and copper alloy seamless pipes and tubes". In addition, be sure that the inner and outer surfaces of the pipes are clean and free of hazardous sulphur, oxides, dust/dirt, shaving particles, oils, moisture, or any other contaminant.**
 - Contaminants on the inside of the refrigerant piping may cause the refrigerant residual oil to deteriorate.
- **Store the piping to be used during installation indoors and keep both ends of the piping sealed until just before brazing. (Store elbows and other joints in a plastic bag.)**
 - If dust, dirt, or water enters the refrigerant cycle, deterioration of the oil and compressor trouble may result.
- **Use liquid refrigerant to fill the system.**
 - If gas refrigerant is used to seal the system, the composition of the refrigerant in the cylinder will change and performance may drop.
- **Do not use a refrigerant other than R32/R410A.**
 - If another refrigerant (R22, etc.) is used, the chlorine in the refrigerant may cause the refrigerator oil to deteriorate.
- **Use a vacuum pump with a reverse flow check valve.**
 - The vacuum pump oil may flow back into the refrigerant cycle and cause the refrigerator oil to deteriorate.
- **Do not use the following tools that are used with conventional refrigerants. (Gauge manifold, charge hose, gas leak detector, reverse flow check valve, refrigerant charge base, vacuum gauge, refrigerant recovery equipment)**
 - If the conventional refrigerant and refrigerator oil are mixed in the R32/R410A, the refrigerant may deteriorate.
 - If water is mixed in the R32/R410A, the refrigerator oil may deteriorate.
 - Since R32/R410A does not contain any chlorine, gas leak detectors for conventional refrigerants will not react to it.
- **Do not use a charging cylinder.**
 - Using a charging cylinder may cause the refrigerant to deteriorate.
- **Be especially careful when managing the tools.**
 - If dust, dirt, or water gets in the refrigerant cycle, the refrigerant may deteriorate.

Cautions for unit using R32 refrigerant

Basic work procedures are the same as those for conventional units using refrigerant R410A. However, pay careful attention to the following points.

- (1) Information on servicing
 - (1-1) Checks on the Area
 - Prior to beginning work on systems containing flammable refrigerants, safety checks are necessary to ensure that the risk of ignition is minimized.
 - For repair to the refrigerating systems, (1-3) to (1-7) shall be completed prior to conducting work on the systems.
 - (1-2) Work Procedure
 - Work shall be undertaken under a controlled procedure so as to minimize the risk of a flammable gas or vapor being present while the work is being performed.
 - (1-3) General Work Area
 - All maintenance staff and others working in the local area shall be instructed on the nature of work being carried out.
 - Work in confined spaces shall be avoided. The area around the workspace shall be sectioned off. Ensure that the conditions within the area

- have been made safe by control of flammable material.
- (1-4) Checking for Presence of Refrigerant
 - The area shall be checked with an appropriate refrigerant detector prior to and during work, to ensure the technician is aware of potentially toxic or flammable atmospheres. Ensure that the leak detection equipment being used is suitable for use with all applicable refrigerants, i.e. non-sparking, adequately sealed or intrinsically safe.
- (1-5) Presence of Fire Extinguisher
 - If any hot work is to be conducted on the refrigeration equipment or any associated parts, appropriate fire extinguishing equipment shall be available to hand.
 - Have a dry powder or CO2 fire extinguisher adjacent to the charging area.
- (1-6) No Ignition Sources
 - No person carrying out work in relation to a refrigeration system which involves exposing any pipe work shall use any sources of ignition in such a manner that it may lead to the risk of fire or explosion. All possible ignition sources, including cigarette smoking, should be kept sufficiently far away from the site of installation, repairing, removing and disposal, during which refrigerant can possibly be released to the surrounding space. Prior to work taking place, the area around the equipment is to be surveyed to make sure that there are no flammable hazards or ignition risks. "No Smoking" signs shall be displayed.
- (1-7) Ventilated Area
 - Ensure that the area is in the open or that it is adequately ventilated before breaking into the system or conducting any hot work. A degree of ventilation shall continue during the period that the work is carried out. The ventilation should safely disperse any released refrigerant and preferably expel it externally into the atmosphere.
- (1-8) Checks on the Refrigeration Equipment
 - Where electrical components are being changed, they shall be fit for the purpose and to the correct specification. At all times the manufacturer's maintenance and service guidelines shall be followed. If in doubt, consult the manufacturer's technical department for assistance.
 - The following checks shall be applied to installations using flammable refrigerants:
 - The charge size is in accordance with the room size within which the refrigerant containing parts are installed.
 - The ventilation machinery and outlets are operating adequately and are not obstructed.
 - Marking to the equipment continues to be visible and legible. Markings and signs that are illegible shall be corrected.
 - Refrigeration pipe or components are installed in a position where they are unlikely to be exposed to any substance which may corrode refrigerant containing components, unless the components are constructed of materials which are inherently resistant to being corroded or are suitably protected against being corroded.
- (1-9) Checks on Electrical Devices
 - Repair and maintenance to electrical components shall include initial safety checks and component inspection procedures.
 - If a fault exists that could compromise safety, then no electrical supply shall be connected to the circuit until it is satisfactorily dealt with. If the fault cannot be corrected immediately but it is necessary to continue operation, an adequate temporary solution shall be used. This shall be reported to the owner of the equipment so all parties are advised.
 - Initial safety checks shall include that:
 - capacitors are discharged: this shall be done in a safe manner to avoid possibility of sparking;
 - no live electrical components and wiring are exposed while charging, recovering or purging the system;
 - there is continuity of earth bonding
- (2) Sealed electrical components
 - Sealed electrical components shall not be repaired.
- (3) Repair to intrinsically Safe Components
 - Do not apply any permanent inductive or capacitance loads to the circuit without ensuring that this will not exceed the permissible voltage and current permitted for the equipment in use.
 - Intrinsically safe components are the only types that can be worked on while live in the presence of a flammable atmosphere. The test apparatus shall be at the correct rating.
 - Replace components only with parts specified by the manufacturer. Other parts may result in the ignition of refrigerant in the atmosphere from a leak.
- (4) Cabling
 - Check that cabling will not be subject to wear, corrosion, excessive pressure, vibration, sharp edges or any other adverse environmental effects. The check shall also take into account the effects of aging or continual vibration from sources such as compressors or fans.
- (5) Detection of Flammable Refrigerants
 - Under no circumstances shall potential sources of ignition be used in the searching for or detection of refrigerant leaks.
 - A halide torch (or any other detector using a naked flame) shall not be used.

(6) Leak Detection Methods

Electronic leak detectors may be used to detect refrigerant leaks but, in the case of flammable refrigerants, the sensitivity may not be adequate, or may need re-calibration. (Detection equipment shall be calibrated in a refrigerant-free area.)

Ensure that the detector is not a potential source of ignition and is suitable for the refrigerant used. Leak detection equipment shall be set at a percentage of the LFL of the refrigerant and shall be calibrated to the refrigerant employed, and the appropriate percentage of gas (25% maximum) is confirmed.

Leak detection fluids are suitable for use with most refrigerants but the use of detergents containing chlorine shall be avoided as the chlorine may react with the refrigerant and corrode the copper pipe-work.

If a leak is suspected, all naked flames shall be removed/extinguished. If a leakage of refrigerant is found which requires brazing, all of the refrigerant shall be recovered from the system, or isolated (by means of shut off valves) in a part of the system remote from the leak. For appliances containing flammable refrigerants, oxygen free nitrogen (OFN) shall then be purged through the system both before and during the brazing process.

(7) Refrigerant removal and circuit evacuation

When breaking into the refrigerant circuit to make repairs – or for any other purpose conventional procedures shall be used. However, for flammable refrigerants it is important that best practice is followed since flammability is a consideration. The following procedure shall be adhered to:

- safely remove refrigerant following local and national regulations;
- evacuate
- purge the circuit with inert gas
- evacuate
- continuously flush with inert gas when using flame to open circuit;
- open the circuit.

The refrigerant charge shall be recovered into the correct recovery cylinders. For appliances containing flammable refrigerants, the system shall be “flushed” with OFN to render the unit safe. This process may need to be repeated several times.

Compressed air or oxygen shall not be used for purging refrigerant systems. For appliances containing flammable refrigerants, flushing shall be achieved by breaking the vacuum in the system with OFN and continuing to fill until the working pressure is achieved, then venting to atmosphere, and finally pulling down to a vacuum. This process shall be repeated until no refrigerant is within the system. When the final OFN charge is used, the system shall be vented down to atmospheric pressure to enable work to take place. This operation is absolutely vital if brazing operations on the pipe-work are to take place.

Ensure that the outlet for the vacuum pump is not close to any ignition sources and that ventilation is available.

(8) Charging Procedures

In addition to conventional charging procedures, the following requirements shall be followed:

- Ensure that contamination of different refrigerants does not occur when using charging equipment. Hoses or lines shall be as short as possible to minimize the amount of refrigerant contained in them.
- Cylinders shall be kept upright.
- Ensure that the refrigeration system is earthed prior to charging the system with refrigerant.
- Label the system when charging is complete (if not already).
- Extreme care shall be taken not to overfill the refrigeration system.

Prior to recharging the system, it shall be pressure-tested with the appropriate purging gas. The system shall be leak-tested on completion of charging but prior to commissioning. A follow up leak test shall be carried out prior to leaving the site.

(9) Decommissioning

Before carrying out this procedure, it is essential that the technician is completely familiar with the equipment and all its detail. It is recommended good practice that all refrigerants are recovered safely. Prior to the task being carried out, an oil and refrigerant sample shall be taken in case analysis is required prior to re-use of reclaimed refrigerant. It is essential that electrical power is available before the task is commenced.

- Become familiar with the equipment and its operation.
- Isolate system electrically.
- Before attempting the procedure, ensure that:
 - mechanical handling equipment is available, if required, for handling refrigerant cylinders;
 - all personal protective equipment is available and being used correctly;
 - the recovery process is supervised at all times by a competent person;
 - recovery equipment and cylinders conform to the appropriate standards.
- Pump down refrigerant system, if possible.
- If a vacuum is not possible, make a manifold so that refrigerant can be removed from various parts of the system.
- Make sure that cylinder is situated on the scales before recovery takes place.

g) Start the recovery machine and operate in accordance with manufacturer's instructions.

h) Do not overfill cylinders. (No more than 80 % volume liquid charge).

i) Do not exceed the maximum working pressure of the cylinder, even temporarily.

j) When the cylinders have been filled correctly and the process completed, make sure that the cylinders and the equipment are removed from site promptly and all isolation valves on the equipment are closed off.

k) Recovered refrigerant shall not be charged into another refrigeration system unless it has been cleaned and checked.

(10) Labelling

Equipment shall be labelled stating that it has been de-commissioned and emptied of refrigerant. The label shall be dated and signed. For appliances containing flammable refrigerants, ensure that there are labels on the equipment stating the equipment contains flammable refrigerant.

(11) Recovery

When removing refrigerant from a system, either for servicing or decommissioning, it is recommended good practice that all refrigerants are removed safely. When transferring refrigerant into cylinders, ensure that only appropriate refrigerant recovery cylinders are employed. Ensure that the correct number of cylinders for holding the total system charge are available. All cylinders to be used are designated for the recovered refrigerant and labelled for that refrigerant (i.e. special cylinders for the recovery of refrigerant). Cylinders shall be complete with pressure-relief valve and associated shut-off valves in good working order. Empty recovery cylinders are evacuated and, if possible, cooled before recovery occurs.

The recovery equipment shall be in good working order with a set of instructions concerning the equipment that is at hand and shall be suitable for the recovery of all appropriate refrigerants including, when applicable, flammable refrigerants. In addition, a set of calibrated weighing scales shall be available and in good working order. Hoses shall be complete with leak-free disconnect couplings and in good condition. Before using the recovery machine, check that it is in satisfactory working order, has been properly maintained and that any associated electrical components are sealed to prevent ignition in the event of a refrigerant release. Consult manufacturer if in doubt.

The recovered refrigerant shall be processed according to local legislation in the correct recovery cylinder, and the relevant waste transfer note arranged. Do not mix refrigerants in recovery units and especially not in cylinders.

If compressors or compressor oils are to be removed, ensure that they have been evacuated to an acceptable level to make certain that flammable refrigerant does not remain within the lubricant. The compressor body shall not be heated by an open flame or other ignition sources to accelerate this process. Draining of oil from a system shall be carried out safely.

CONTENTS

I Features

[1] Features.....	1
-------------------	---

II Components and Functions

[1] Components and Functions.....	2
-----------------------------------	---

III Specifications

[1] Specifications.....	5
1.Specifications.....	5
2.Electrical component specifications.....	13

IV Outlines and Dimensions

[1] Outlines and Dimensions.....	15
[2] Service Space.....	16

V Wiring Diagram

[1] Wiring Diagram.....	17
-------------------------	----

VI Refrigerant System Diagram

[1] Refrigerant system diagram.....	18
-------------------------------------	----

VII Wiring for interlock between the refrigerant leak sensor output and local equipment

[1] Wiring for interlock between the refrigerant leak sensor output and local equipment	19
-----------------------------------------------------------------------------------------------	----

VIII Troubleshooting

[1] Troubleshooting.....	20
1.Countermeasures for error during test run	20
2.Check methods.....	21
3.DC fan motor (fan motor/indoor control board).....	26
4.Address switch setting.....	27
5.Voltage test points on the control board	28
6.Setting (Factory setting).....	29

IX Disassembly Procedure


[1] Disassembly Procedure.....	33
1.Control box	33
2.Thermistor (Intake air)	34
3.LEV, thermistor (Liquid/Gas piping temperature detection).....	34
4.Drain pan	35
5.Heat exchanger	36
6.Fan and fan motor	37
7.R32 sensor	38

X Inspection and maintenance

[1] Inspection and maintenance.....	39
1.Guideline for preventive maintenance	39
2.Recommended parts inspection interval.....	40



[1] Features

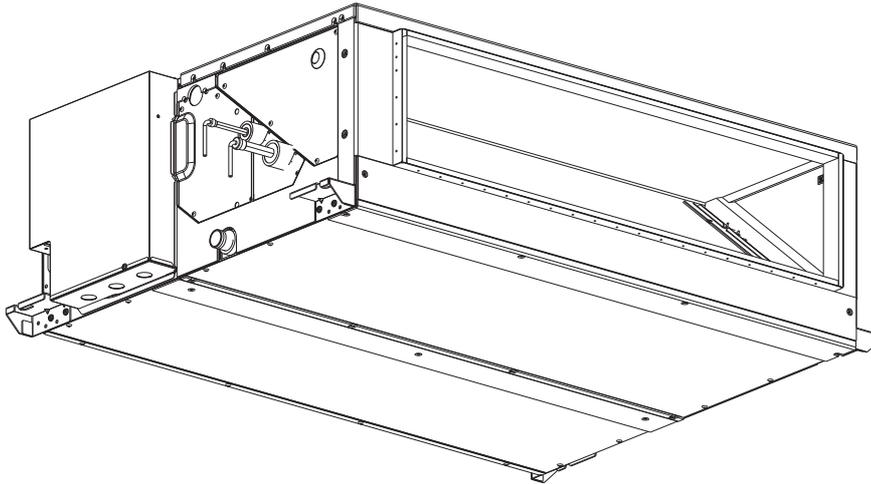


Model	Cooling capacity/Heating capacity
	kW
PEFY-MS40VMHS-A	4.5/5.0
PEFY-MS50VMHS-A	5.6/6.3
PEFY-MS63VMHS-A	7.1/8.0
PEFY-MS71VMHS-A	8.0/9.0
PEFY-MS80VMHS-A	9.0/10.0
PEFY-MS100VMHS-A	11.2/12.5
PEFY-MS125VMHS-A	14.0/16.0
PEFY-MS140VMHS-A	16.0/18.0

[1] Components and Functions

1. Indoor (Main) Unit


In case of rear inlet

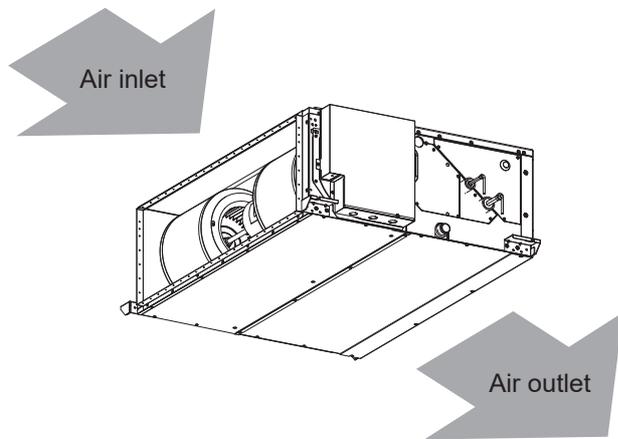

2. Remote Controller <PAR-42MAAB>

Once the operation mode is selected, the unit will remain in the selected mode until changed.

(1) Remote Controller Buttons

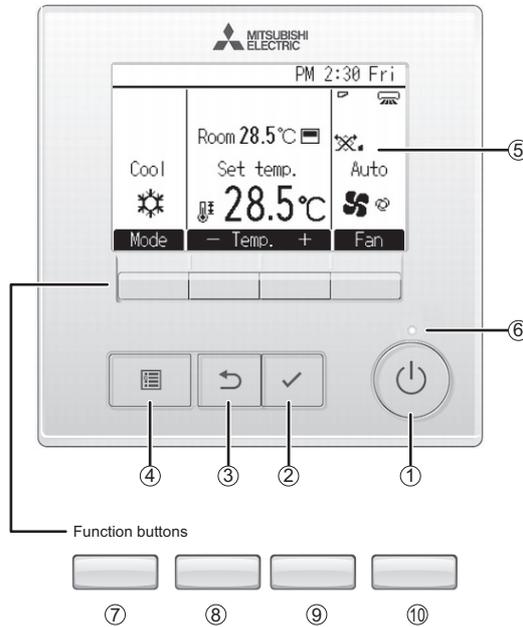

① [ON/OFF] button

Press to turn ON/OFF the indoor unit.

② [SELECT] button

Press to save the setting.

③ [RETURN] button

Press to return to the previous screen.

④ [MENU] button

Press to bring up the Main menu.

⑤ Backlit LCD


Operation settings will appear.
When the backlight is off, pressing any button turns the backlight on and it will stay lit for a certain period of time depending on the screen.

When the backlight is off, pressing any button turns the backlight on and does not perform its function. (except for the [ON/OFF] button)

⑥ ON/OFF lamp

This lamp lights up in green while the unit is in operation. It blinks while the remote controller is starting up or when there is an error.

The functions of the function buttons change depending on the screen. Refer to the button function guide that appears at the bottom of the LCD for the functions they serve on a given screen. When the system is centrally controlled, the button function guide that corresponds to the locked button will not appear.

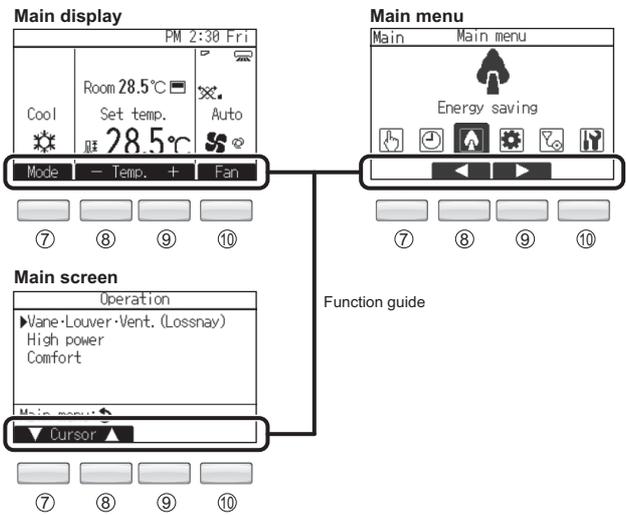

⑦ Function button [F1]

Main display: Press to change the operation mode.
Menu screen: The button function varies with the screen.

⑧ Function button [F2]

Main display: Press to decrease temperature.
Main menu: Press to move the cursor left.
Menu screen: The button function varies with the screen.

⑨ Function button [F3]

Main display: Press to increase temperature.
Main menu: Press to move the cursor right.
Menu screen: The button function varies with the screen.

⑩ Function button [F4]


Main display: Press to change the fan speed.
Menu screen: The button function varies with the screen.

(2) Remote Controller Display


The main display can be displayed in two different modes: "Full" and "Basic." The factory setting is "Full." To switch to the "Basic" mode, change the setting on the Main display setting.

Full mode

* All icons are displayed for explanation.

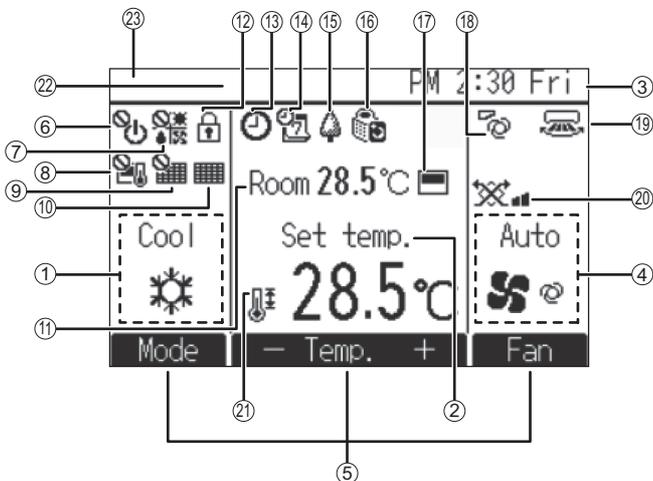

Basic mode

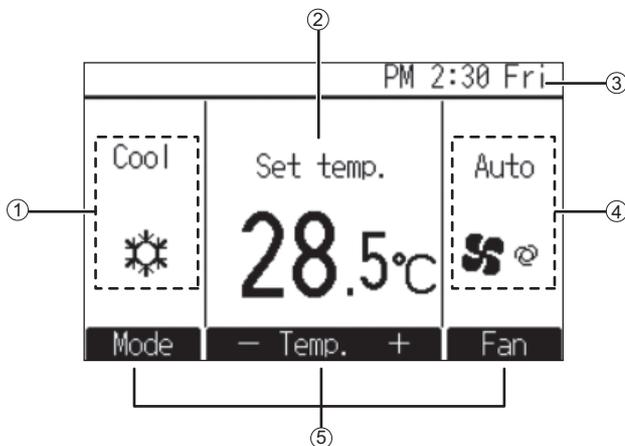

- ① Operation mode**
Indoor unit operation mode appears here.
- ② Set temperature**
Set temperature appears here.
- ③ Clock**
Current time appears here.
- ④ Fan speed**
Fan speed setting appears here.
- ⑤ Button function guide**
Functions of the corresponding buttons appear here.
- ⑥**
Appears when the ON/OFF operation is centrally controlled.
- ⑦**
Appears when the operation mode is centrally controlled.
- ⑧**
Appears when the set temperature is centrally controlled.
- ⑨**
Appears when the filter reset function is centrally controlled.
- ⑩**
Indicates when filter needs maintenance.
- ⑪ Room temperature**
Current room temperature appears here.
- ⑫**
Appears when the buttons are locked.
- ⑬**
Appears when the On/Off timer, Night setback, or Auto-off timer function is enabled.
 appears when the timer is disabled by the centralized control system.
- ⑭**
Appears when the Weekly timer is enabled.

- ⑮**
Appears while the units are operated in the energy-save mode. (Will not appear on some models of indoor units)
- ⑯**
Appears while the outdoor units are operated in the silent mode.
- ⑰**
Appears when the built-in thermistor on the remote controller is activated to monitor the room temperature (⑪).
 appears when the thermistor on the indoor unit is activated to monitor the room temperature.
- ⑱**
Indicates the vane setting.
- ⑲**
Indicates the louver setting.
- ⑳**
Indicates the ventilation setting.
- ㉑**
Appears when the set temperature range is restricted.
- ㉒ Centrally controlled**
Appears for a certain period of time when a centrally-controlled item is operated.
- ㉓ Preliminary error display**
An error code appears during the preliminary error.

Most settings (except ON/OFF, mode, fan speed, temperature) can be made from the Main menu.

[1] Specifications

1. Specifications

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL	PEFY-MS40VMHS-A
Power source			1-phase 220-230-240 V 50/60 Hz	
Cooling capacity (Nominal)	*1	kW	4.5	
	*1	BTU/h	15,400	
	*2	Power input kW	0.055	
	*2	Current input A	(220-230-240 V) 0.41-0.39-0.38	
Heating capacity (Nominal)	*3	kW	5.0	
	*3	BTU/h	17,100	
	*2	Power input kW	0.055	
	*2	Current input A	(220-230-240 V) 0.41-0.39-0.38	
External finish			Galvanized steel plate	
External dimension HxWxD		mm	380 x 745 x 900	
		in.	15 x 29-3/8 x 35-7/16	
Net weight		kg (lbs)	35.0 (78)	
Heat exchanger			Cross fin (Aluminum fin and copper tube)	
FAN	Type x Quantity		Sirocco fan x 1	
	*4 External static press.	Pa	50 - <100> - <150> - <200>	
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>	
	Motor Type		DC motor	
	Motor output kW		0.121	
	Driving mechanism		Direct-driven by motor	
	Air flow rate		(Low-Mid-High)	
			m ³ /min	10.0 - 12.0 - 14.0
L/s			167 - 200 - 233	
		cfm	353 - 424 - 494	
Sound pressure level (measured in anechoic room)		(Low-Mid-High)		
*2 dB (A)		22.0-25.0-29.0		
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam	
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.	
Protection device			Fuse	
Refrigerant control device			LEV	
Connectable outdoor unit		*5	R32, R410A CITY MULTI	
Refrigerant diameter	Liquid	mm (in.)	6.35 (1/4)Braze	
	Gas	mm (in.)	12.7 (1/2)Braze	
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)	
Drawing	External		KB94CAAB	
	Wiring		KB94CAAC	
	Refrigerant cycle		-	
Standard attachment	Document		Installation Manual, Instruction Book	
	Accessory		Washer, Drain socket, Tie band, Reducer	
Optional parts	Drain pump kit		PAC-DRP10DP-E2	
	Long life filter		PAC-KE86LAF	
	Filter box		PAC-KE63TB-F	
Remarks				
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.				
* Due to continuing improvement, above specifications may be subject to change without notice.				
Notes:			Unit converter	
1.Nominal cooling conditions			BTU/h =kW x 3,412	
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31	
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536	
2.The values are measured at the factory setting of external static pressure.				
3.Nominal heating conditions				
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)				
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)				
4.The factory setting of airflow mode and external static pressure mode is shown without < >.				
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.				
5.For more detailed information, contact your local distributor.				
			*Above specification data is subject to rounding variation.	

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL	PEFY-MS50VMHS-A
Power source			1-phase 220-230-240 V 50/60 Hz	
Cooling capacity (Nominal)	*1	kW	5.6	
	*1	BTU/h	19,100	
	*2	Power input kW	0.055	
	*2	Current input A	(220-230-240 V) 0.41-0.39-0.38	
Heating capacity (Nominal)	*3	kW	6.3	
	*3	BTU/h	21,500	
	*2	Power input kW	0.055	
	*2	Current input A	(220-230-240 V) 0.41-0.39-0.38	
External finish			Galvanized steel plate	
External dimension HxWxD		mm	380 x 745 x 900	
		in.	15 x 29-3/8 x 35-7/16	
Net weight		kg (lbs)	35.0 (78)	
Heat exchanger			Cross fin (Aluminum fin and copper tube)	
FAN	Type x Quantity		Sirocco fan x 1	
	*4 External static press.	Pa	50 - <100> - <150> - <200>	
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>	
	Motor Type		DC motor	
	Motor output kW		0.121	
	Driving mechanism		Direct-driven by motor	
	Air flow rate		(Low-Mid-High)	
			m ³ /min	10.0 - 12.0 - 14.0
L/s			167 - 200 - 233	
		cfm	353 - 424 - 494	
Sound pressure level (measured in anechoic room)			(Low-Mid-High)	
		*2 dB (A)	22.0-25.0-29.0	
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam	
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.	
Protection device			Fuse	
Refrigerant control device			LEV	
Connectable outdoor unit		*5	R32, R410A CITY MULTI	
Refrigerant diameter	Liquid	mm (in.)	6.35 (1/4)Braze	
	Gas	mm (in.)	12.7 (1/2)Braze	
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)	
Drawing	External		KB94CAAB	
	Wiring		KB94CAAC	
	Refrigerant cycle		-	
Standard attachment	Document		Installation Manual, Instruction Book	
	Accessory		Washer, Drain socket, Tie band, Reducer	
Optional parts	Drain pump kit		PAC-DRP10DP-E2	
	Long life filter		PAC-KE86LAF	
	Filter box		PAC-KE63TB-F	
Remarks				
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual				
* Due to continuing improvement, above specifications may be subject to change without notice.				
Notes:			Unit converter	
1.Nominal cooling conditions			BTU/h =kW x 3,412	
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31	
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536	
2.The values are measured at the factory setting of external static pressure.				
3.Nominal heating conditions				
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)				
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)				
4.The factory setting of airflow mode and external static pressure mode is shown without < >.				
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.				
5.For more detailed information, contact your local distributor.			*Above specification data is subject to rounding variation.	

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL
MODEL			PEFY-MS63VMHS-A
Power source			1-phase 220-230-240 V 50/60 Hz
Cooling capacity (Nominal)	*1	kW	7.1
	*1	BTU/h	24,200
	*2	Power input kW	0.090
	*2	Current input A	(220-230-240 V) 0.64-0.62-0.59
Heating capacity (Nominal)	*3	kW	8.0
	*3	BTU/h	27,300
	*2	Power input kW	0.090
	*2	Current input A	(220-230-240 V) 0.64-0.62-0.59
External finish			Galvanized steel plate
External dimension HxWxD		mm	380 x 745 x 900
		in.	15 x 29-3/8 x 35-7/16
Net weight		kg (lbs)	35.0 (78)
Heat exchanger			Cross fin (Aluminum fin and copper tube)
FAN	Type x Quantity		Sirocco fan x 1
	*4 External static press.	Pa	50 - <100> - <150> - <200>
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>
	Motor Type		DC motor
	Motor output		0.121 kW
	Driving mechanism		Direct-driven by motor
	Air flow rate		(Low-Mid-High)
			m ³ /min
L/s			225 - 267 - 317
		cfm	477 - 565 - 671
Sound pressure level (measured in anechoic room)			(Low-Mid-High)
		*2 dB (A)	25.0-28.5-33.5
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.
Protection device			Fuse
Refrigerant control device			LEV
Connectable outdoor unit		*6	R32, R410A CITY MULTI
Refrigerant diameter	Liquid	*5 mm (in.)	6.35 (1/4)Brazed
	Gas	mm (in.)	9.52 (3/8)Brazed 15.88 (5/8)Brazed
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)
Drawing	External		KB94CAAB
	Wiring		KB94CAAC
	Refrigerant cycle		-
Standard attachment	Document		Installation Manual, Instruction Book
	Accessory		Washer, Drain socket, Tie band, Reducer
Optional parts	Drain pump kit		PAC-DRP10DP-E2
	Long life filter		PAC-KE86LAF
	Filter box		PAC-KE63TB-F
Remarks			
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.			
* Due to continuing improvement, above specifications may be subject to change without notice.			
Notes:			Unit converter
1.Nominal cooling conditions			BTU/h =kW x 3,412
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536
2.The values are measured at the factory setting of external static pressure.			
3.Nominal heating conditions			
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)			
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			
4.The factory setting of airflow mode and external static pressure mode is shown without < >.			
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.			
5.It is possible to reduce the pipe size to Ф6.35 using a "Reducer" included in the accessory bag.			
The pipe size required depends on the connected outdoor unit, so check the Outdoor Unit Installation Manual to confirm whether the Reducer can be used.			
6.For more detailed information, contact your local distributor.			
			*Above specification data is subject to rounding variation.

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			
MODEL		PEFY-MS71VMHS-A	
Power source		1-phase 220-230-240 V 50/60 Hz	
Cooling capacity (Nominal)	*1 kW	8.0	
	*1 BTU/h	27,300	
	*2 Power input kW	0.075	
	*2 Current input A (220-230-240 V)	0.54-0.52-0.50	
Heating capacity (Nominal)	*3 kW	9.0	
	*3 BTU/h	30,700	
	*2 Power input kW	0.075	
	*2 Current input A (220-230-240 V)	0.54-0.52-0.50	
External finish		Galvanized steel plate	
External dimension HxWxD		mm	380 x 1,030 x 900
		in.	15 x 40-9/16 x 35-7/16
Net weight		kg (lbs)	45.0 (100)
Heat exchanger		Cross fin (Aluminum fin and copper tube)	
FAN	Type x Quantity		Sirocco fan x 2
	*4 External static press.	Pa	50 - <100> - <150> - <200>
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>
	Motor Type		DC motor
	Motor output kW		0.244
	Driving mechanism		Direct-driven by motor
	Air flow rate		(Low-Mid-High)
			m ³ /min
L/s			258 - 300 - 367
		cfm	547 - 636 - 777
Sound pressure level (measured in anechoic room)		(Low-Mid-High)	
*2 dB (A)		25.0-27.5-31.0	
Insulation material		EPS, Polystyrene foam, Polyethylene foam, Urethane foam	
Air filter		Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.	
Protection device		Fuse	
Refrigerant control device		LEV	
Connectable outdoor unit *6		R32, R410A CITY MULTI	
Refrigerant diameter	Liquid *5	mm (in.)	6.35 (1/4)Braze 9.52 (3/8)Braze
	Gas	mm (in.)	15.88 (5/8)Braze
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)
Drawing	External		KB94CAAB
	Wiring		KB94CAAC
	Refrigerant cycle		-
Standard attachment	Document		Installation Manual, Instruction Book
	Accessory		Washer, Drain socket, Tie band
Optional parts	Drain pump kit		PAC-DRP10DP-E2
	Long life filter		PAC-KE88LAF
	Filter box		PAC-KE99TB-F
Remarks			
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.			
* Due to continuing improvement, above specifications may be subject to change without notice.			
Notes:			Unit converter
1.Nominal cooling conditions			BTU/h =kW x 3,412
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536
2.The values are measured at the factory setting of external static pressure.			
3.Nominal heating conditions			
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)			
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			
4.The factory setting of airflow mode and external static pressure mode is shown without < >.			
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.			
5.It is possible to reduce the pipe size to Ф6.35 using a "Reducer" included in the accessory bag.			
The pipe size required depends on the connected outdoor unit, so check the Outdoor Unit Installation Manual to confirm whether the Reducer can be used.			
6.For more detailed information, contact your local distributor.			
			*Above specification data is subject to rounding variation.

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL
MODEL			PEFY-MS80VMHS-A
Power source			1-phase 220-230-240 V 50/60 Hz
Cooling capacity (Nominal)	*1	kW	9.0
	*1	BTU/h	30,700
	*2	Power input kW	0.090
	*2	Current input A	(220-230-240 V) 0.63-0.61-0.58
Heating capacity (Nominal)	*3	kW	10.0
	*3	BTU/h	34,100
	*2	Power input kW	0.090
	*2	Current input A	(220-230-240 V) 0.63-0.61-0.58
External finish			Galvanized steel plate
External dimension HxWxD		mm	380 x 1,030 x 900
		in.	15 x 40-9/16 x 35-7/16
Net weight		kg (lbs)	45.0 (100)
Heat exchanger			Cross fin (Aluminum fin and copper tube)
FAN	Type x Quantity		Sirocco fan x 2
	*4 External static press.	Pa	50 - <100> - <150> - <200>
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>
	Motor Type		DC motor
	Motor output kW		0.244
	Driving mechanism		Direct-driven by motor
	Air flow rate		(Low-Mid-High)
			m ³ /min
L/s			300 - 358 - 417
		cfm	636 - 759 - 883
Sound pressure level (measured in anechoic room)			(Low-Mid-High)
		*2 dB (A)	26.5-28.5-31.0
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.
Protection device			Fuse
Refrigerant control device			LEV
Connectable outdoor unit *6			R32, R410A CITY MULTI
Refrigerant diameter	Liquid *5	mm (in.)	6.35 (1/4)Braze 9.52 (3/8)Braze
		Gas	mm (in.) 15.88 (5/8)Braze
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)
Drawing	External		KB94CAAB
	Wiring		KB94CAAC
	Refrigerant cycle		-
Standard attachment	Document		Installation Manual, Instruction Book
	Accessory		Washer, Drain socket, Tie band
Optional parts	Drain pump kit		PAC-DRP10DP-E2
	Long life filter		PAC-KE88LAF
	Filter box		PAC-KE99TB-F
Remarks			
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.			
* Due to continuing improvement, above specifications may be subject to change without notice.			
Notes:			Unit converter
1.Nominal cooling conditions			BTU/h =kW x 3,412
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536
2.The values are measured at the factory setting of external static pressure.			
3.Nominal heating conditions			
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)			
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			
4.The factory setting of airflow mode and external static pressure mode is shown without < >.			
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.			
5.It is possible to reduce the pipe size to Φ6.35 using a "Reducer" included in the accessory bag.			
The pipe size required depends on the connected outdoor unit, so check the Outdoor Unit Installation Manual to confirm whether the Reducer can be used.			
6.For more detailed information, contact your local distributor.			
			*Above specification data is subject to rounding variation.

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL	
MODEL			PEFY-MS100VMHS-A	
Power source			1-phase 220-230-240 V 50/60 Hz	
Cooling capacity (Nominal)	*1	kW	11.2	
	*1	BTU/h	38,200	
	*2	Power input kW	0.160	
	*2	Current input A	(220-230-240 V) 1.05-1.01-0.96	
Heating capacity (Nominal)	*3	kW	12.5	
	*3	BTU/h	42,700	
	*2	Power input kW	0.160	
	*2	Current input A	(220-230-240 V) 1.05-1.01-0.96	
External finish			Galvanized steel plate	
External dimension HxWxD		mm	380 x 1,195 x 900	
		in.	15 x 47-1/16 x 35-7/16	
Net weight		kg (lbs)	51.0 (113)	
Heat exchanger			Cross fin (Aluminum fin and copper tube)	
FAN	Type x Quantity		Sirocco fan x 2	
	*4	External static press.	Pa	50 - <100> - <150> - <200>
			mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>
	Motor Type		DC motor	
	Motor output		kW	0.375
	Driving mechanism		Direct-driven by motor	
	Air flow rate		(Low-Mid-High)	
			m ³ /min	26.5 - 32.0 - 38.0
			L/s	442 - 533 - 633
			cfm	936 - 1,130 - 1,342
Sound pressure level (measured in anechoic room)			(Low-Mid-High)	
*2		dB (A)	28.0-32.0-35.5	
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam	
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.	
Protection device			Fuse	
Refrigerant control device			LEV	
Connectable outdoor unit		*5	R32, R410A CITY MULTI	
Refrigerant diameter	Liquid	mm (in.)	9.52 (3/8)Braze	
	Gas	mm (in.)	15.88 (5/8)Braze	
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)	
Drawing	External		KB94CAAB	
	Wiring		KB94CAAC	
	Refrigerant cycle		-	
Standard attachment	Document		Installation Manual, Instruction Book	
	Accessory		Washer, Drain socket, Tie band, Reducer	
Optional parts	Drain pump kit		PAC-DRP10DP-E2	
	Long life filter		PAC-KE89LAF	
	Filter box		PAC-KE140TB-F	
Remarks				
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.				
* Due to continuing improvement, above specifications may be subject to change without notice.				
Notes:			Unit converter	
1.Nominal cooling conditions			BTU/h =kW x 3,412	
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31	
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536	
2.The values are measured at the factory setting of external static pressure.				
3.Nominal heating conditions				
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)				
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)				
4.The factory setting of airflow mode and external static pressure mode is shown without < >.				
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.				
5.For more detailed information, contact your local distributor.				
			*Above specification data is subject to rounding variation.	

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL	PEFY-MS125VMHS-A
Power source			1-phase 220-230-240 V 50/60 Hz	
Cooling capacity (Nominal)	*1	kW	14.0	
	*1	BTU/h	47,800	
	*2	Power input kW	0.283	
	*2	Current input A	(220-230-240 V) 1.86-1.782-1.716	
Heating capacity (Nominal)	*3	kW	16.0	
	*3	BTU/h	54,600	
	*2	Power input kW	0.283	
	*2	Current input A	(220-230-240 V) 1.86-1.782-1.716	
External finish			Galvanized steel plate	
External dimension HxWxD		mm	380 x 1,195 x 900	
		in.	15 x 47-1/16 x 35-7/16	
Net weight		kg (lbs)	51.0 (113)	
Heat exchanger			Cross fin (Aluminum fin and copper tube)	
FAN	Type x Quantity		Sirocco fan x 2	
	*4 External static press.	Pa	50 - <100> - <150> - <200>	
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>	
	Motor Type		DC motor	
	Motor output kW		0.375	
	Driving mechanism		Direct-driven by motor	
	Air flow rate		(Low-Mid-High)	
			m ³ /min	28.0 - 34.0 - 45.5
L/s			467 - 567 - 758	
		cfm	989 - 1,201 - 1,607	
Sound pressure level (measured in anechoic room)			(Low-Mid-High)	
		*2 dB (A)	28.5-33.0-40.0	
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam	
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.	
Protection device			Fuse	
Refrigerant control device			LEV	
Connectable outdoor unit *5			R32, R410A CITY MULTI	
Refrigerant diameter	Liquid	mm (in.)	9.52 (3/8)Braze	
	Gas	mm (in.)	15.88 (5/8)Braze	
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)	
Drawing	External		KB94CAAB	
	Wiring		KB94CAAC	
	Refrigerant cycle		-	
Standard attachment	Document		Installation Manual, Instruction Book	
	Accessory		Washer, Drain socket, Tie band, Reducer	
Optional parts	Drain pump kit		PAC-DRP10DP-E2	
	Long life filter		PAC-KE89LAF	
	Filter box		PAC-KE140TB-F	
Remarks				
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.				
* Due to continuing improvement, above specifications may be subject to change without notice.				
Notes:			Unit converter	
1.Nominal cooling conditions			BTU/h =kW x 3,412	
Indoor: 27 ° C D.B./19 ° C W.B. (81 ° F D.B./66 ° F W.B.), Outdoor: 35 ° C D.B. (95 ° F D.B.)			cfm =m ³ /min x 35.31	
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536	
2.The values are measured at the factory setting of external static pressure.				
3.Nominal heating conditions				
Indoor: 20 ° CD.B. (68 ° FD.B.), Outdoor: 7 ° CD.B./6 ° CW.B. (45 ° FD.B./43 ° FW.B.)				
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)				
4.The factory setting of airflow mode and external static pressure mode is shown without < >.				
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.				
5.For more detailed information, contact your local distributor.			*Above specification data is subject to rounding variation.	

SPECIFICATIONS OF Air Conditioner (Ceiling-concealed TYPE)			MODEL	
MODEL			PEFY-MS140VMHS-A	
Power source			1-phase 220-230-240 V 50/60 Hz	
Cooling capacity (Nominal)	*1	kW	16.0	
	*1	BTU/h	54,600	
	*2	Power input kW	0.286	
	*2	Current input A	(220-230-240 V) 1.848-1.771-1.694	
Heating capacity (Nominal)	*3	kW	18.0	
	*3	BTU/h	61,400	
	*2	Power input kW	0.286	
	*2	Current input A	(220-230-240 V) 1.848-1.771-1.694	
External finish			Galvanized steel plate	
External dimension HxWxD		mm	380 x 1,195 x 900	
		in.	15 x 47-1/16 x 35-7/16	
Net weight		kg (lbs)	53.0 (117)	
Heat exchanger			Cross fin (Aluminum fin and copper tube)	
FAN	Type x Quantity		Sirocco fan x 2	
	*4 External static press.	Pa	50 - <100> - <150> - <200>	
		mmH ₂ O	5.1 - <10.2> - <15.3> - <20.4>	
	Motor Type		DC motor	
	Motor output		0.375 kW	
	Driving mechanism		Direct-driven by motor	
	Air flow rate		(Low-Mid-High)	
			m ³ /min	28.0 - 34.0 - 45.5
			L/s	467 - 567 - 758
			cfm	989 - 1,201 - 1,607
Sound pressure level (measured in anechoic room)			(Low-Mid-High)	
*2		dB (A)	29.0-33.5-41.0	
Insulation material			EPS, Polystyrene foam, Polyethylene foam, Urethane foam	
Air filter			Option:Synthetic fiber unwoven cloth filter (long life filter) and filter box are recommended.	
Protection device			Fuse	
Refrigerant control device			LEV	
Connectable outdoor unit		*5	R32, R410A CITY MULTI	
Refrigerant diameter	Liquid	mm (in.)	9.52 (3/8)Braze	
	Gas	mm (in.)	15.88 (5/8)Braze	
Field drain pipe size		mm (in.)	O.D.32 (1-1/4)	
Drawing	External		KB94CAAB	
	Wiring		KB94CAAC	
	Refrigerant cycle		-	
Standard attachment	Document		Installation Manual, Instruction Book	
	Accessory		Washer, Drain socket, Tie band, Reducer	
Optional parts	Drain pump kit		PAC-DRP10DP-E2	
	Long life filter		PAC-KE89LAF	
	Filter box		PAC-KE140TB-F	
Remarks				
* Details on foundation work, duct work, insulation work, electrical wiring, power source switch, and other items shall be referred to the Installation Manual.				
* Due to continuing improvement, above specifications may be subject to change without notice.				
Notes:			Unit converter	
1.Nominal cooling conditions			BTU/h =kW x 3,412	
Indoor: 27° C D.B./19° C W.B. (81° F D.B./66° F W.B.), Outdoor: 35° C D.B. (95° F D.B.)			cfm =m ³ /min x 35.31	
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)			lbs =kg/0.4536	
2.The values are measured at the factory setting of external static pressure.				
3.Nominal heating conditions				
Indoor: 20° CD.B. (68° FD.B.), Outdoor: 7° CD.B./6° CW.B. (45° FD.B./43° FW.B.)				
Pipe length: 7.5 m (24-9/16 ft.), Level difference: 0 m (0 ft.)				
4.The factory setting of airflow mode and external static pressure mode is shown without < >.				
Refer to "Fan characteristics curves", according to the external static pressure, in DATA BOOK for the usable range of air flow rate.				
5.For more detailed information, contact your local distributor.				
			*Above specification data is subject to rounding variation.	

2. Electrical component specifications

Component	Sym- bol	PEFY-MS40VMHS-A	PEFY-MS50VMHS-A	PEFY-MS63VMHS-A
Room temperature thermistor	TH21	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ		
Liquid pipe thermistor	TH22	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ		
Gas pipe thermistor	TH23	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ		
Fuse	F1	250 VAC 6.3A		
Fan motor		8-pole, Output 121W SIC-70CW-D8121-3		
Linear expansion valve	LEV	12VDC Stepping motor (0~2000 pulse)		
Power supply terminal block	TB2	(L1, L2) 250V 10A		
Transmission terminal block	TB5 TB15	(1, 2) 300V 16A, (M1, M2, S) 300V 16A		
Drain pump		PMD INPUT 3.9W (13 VDC) 36L/h		
Drain float switch	FS	Open/short detection Initial contact resistance 500 mΩ or less		
R32 sensor	CNSA	5 VDC		

Component	Sym- bol	PEFY-MS71VMHS-A	PEFY-MS80VMHS-A
Room temperature thermistor	TH21	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ	
Liquid pipe thermistor	TH22	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ	
Gas pipe thermistor	TH23	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ	
Fuse	F1	250 VAC 6.3A	
Fan motor		8-pole, Output 244W SIC-101CW-D8244-3	
Linear expansion valve	LEV	12VDC Stepping motor (0~2000 pulse)	
Power supply terminal block	TB2	(L1, L2) 250V 10A	
Transmission terminal block	TB5 TB15	(1, 2) 300V 16A, (M1, M2, S) 300V 16A	
Drain pump		PMD INPUT 3.9W (13 VDC) 36L/h	
Drain float switch	FS	Open/short detection Initial contact resistance 500 mΩ or less	
R32 sensor	CNSA	5 VDC	


Component	Sym- bol	PEFY-MS100VMHS-A	PEFY-MS125VMHS-A	PEFY-MS140VMHS-A
Room temperature thermistor	TH21	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ		
Liquid pipe thermistor	TH22	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ		
Gas pipe thermistor	TH23	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ		
Fuse	F1	250 VAC 6.3A		
Fan motor		8-pole, Output 375W KMUC4E6MW		
Linear expansion valve	LEV	12VDC Stepping motor (0~2000 pulse)		
Power supply terminal block	TB2	(L1, L2) 250V 10A		
Transmission terminal block	TB5 TB15	(1, 2) 300V 16A, (M1, M2, S) 300V 16A		
Drain pump		PMD INPUT 3.9W (13 VDC) 36L/h		
Drain float switch	FS	Open/short detection Initial contact resistance 500 mΩ or less		
R32 sensor	CNSA	5 VDC		

[1] Outlines and Dimensions

1. PEFY-MS40, 50, 63, 71, 80, 100, 125, 140VMHS-A

Unit: mm

- Note 1. Reinforce the suspension bolts with anti-vibration support members as necessary, such as for seismic resistance.
 2. Use M10 bolts to secure the suspension bolts.
 (To be procured on-site)
 3. When cleaning the heat exchanger, ensure sufficient service space is provided, as maintenance will be performed from below.
 4. Always install an air filter (sold separately) on the intake side.
 5. The drain pump is sold separately.
 6. This drawing represents models MS71~140, which feature a dual-fan configuration.
 Models MS40~63 feature a single-fan configuration.
 7. It is possible to reduce the pipe size to $\phi 6.35$ using a "Reducer" included in the accessory bag.
 The pipe size required depends on the connected outdoor unit, so check the Outdoor Unit Installation Manual to confirm whether the Reducer can be used.

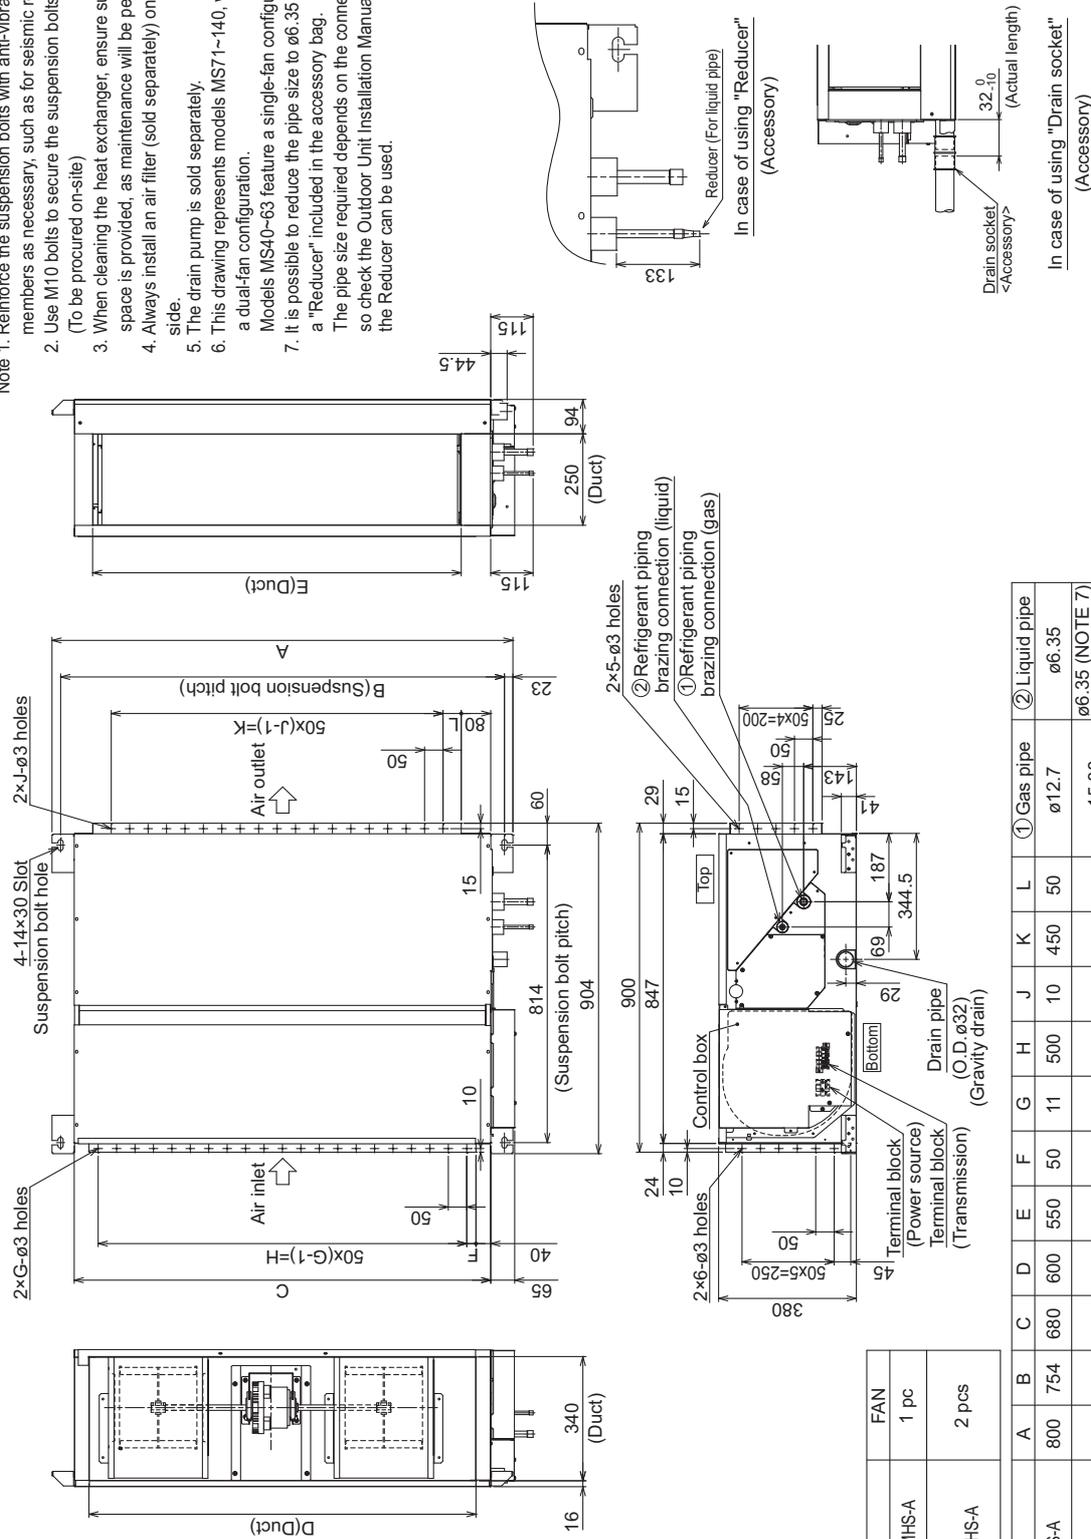

MODEL	A	B	C	D	E	F	G	H	J	K	L	① Gas pipe	② Liquid pipe
PEFY-MS40-50-63VMHS-A	800	754	680	600	550	50	11	500	10	450	50	$\phi 12.7$	$\phi 6.35$
PEFY-MS71-80-100-125-140VMHS-A	800	754	680	600	550	50	11	500	10	450	50	$\phi 15.88$	$\phi 6.35$ (NOTE 7) with "Reducer"
													$\phi 9.52$
PEFY-MS71-80VMHS-A	1085	1039	965	885	835	42.5	17	800	15	700	67	$\phi 15.88$	$\phi 6.35$ (NOTE 7) with "Reducer"
													$\phi 9.52$
PEFY-MS100-125-140VMHS-A	1250	1204	1130	1050	1000	25	21	1000	19	900	50	$\phi 15.88$	$\phi 9.52$

MODEL	FAN
PEFY-MS40-50-63VMHS-A	1 pc
PEFY-MS71-80-100-125-140VMHS-A	2 pcs

[2] Service Space

1. PEFY-MS40, 50, 63, 71, 80, 100, 125, 140VMHS-A

Unit: mm

[Maintenance Access Space]

Ensure sufficient service space is secured for the maintenance, inspection, and replacement of the motor, fan, heat exchanger, drain pan, and control box by adopting one of the following methods. Select an installation location for the indoor unit where maintenance access will not be obstructed by beams or other structural elements.

Provide Access Door 1 (450 x 450 mm) on the side of the unit to allow replacement of the thermistor, LEV, or control box, as shown in Fig. 2 and Fig. 4.

CASE 1: When a clearance of 300 mm or more is available between the unit and the ceiling (See Fig. 1):

Provide Access Door 2 (600 x 600 mm) at the bottom of the unit to allow maintenance (cleaning or replacement) of the motor, fan, heat exchanger, and drain pan. (See Fig. 2)

CASE 2: When a clearance of less than 300 mm is available between the unit and the ceiling:

(Ensure a minimum clearance of 20 mm below the unit, as shown in Fig. 3.)

Provide Access Door 3 at the bottom of the unit to allow maintenance (cleaning or replacement) of the motor, fan, heat exchanger, and drain pan. (See Fig. 4)

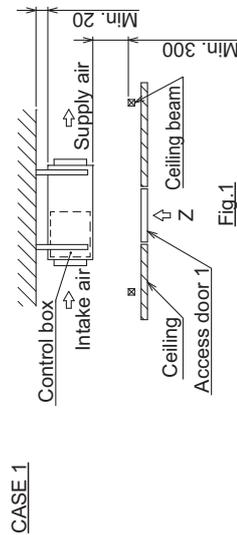


Fig. 1

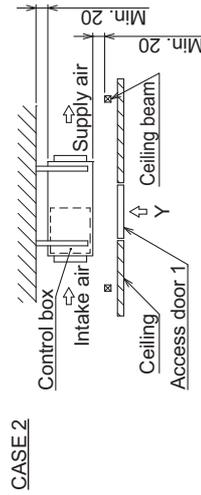


Fig. 3

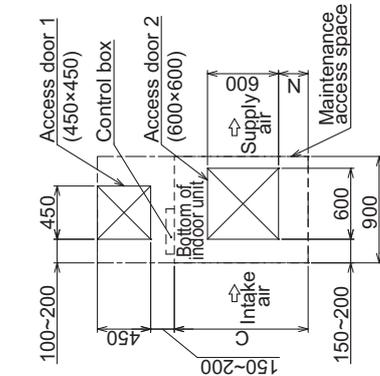


Fig. 2

View from arrow Z


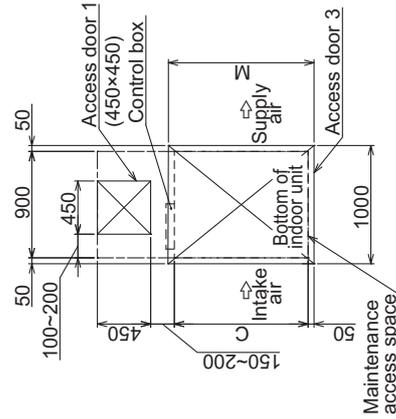


Fig. 4

View from arrow Y

MODEL	C	M	N
PEFY-MS40-50-63VMHS-A	680	780	0~50
PEFY-MS71-80VMHS-A	965	1065	100~150
PEFY-MS100-125-140VMHS-A	1130	1230	200~250

[1] Refrigerant system diagram

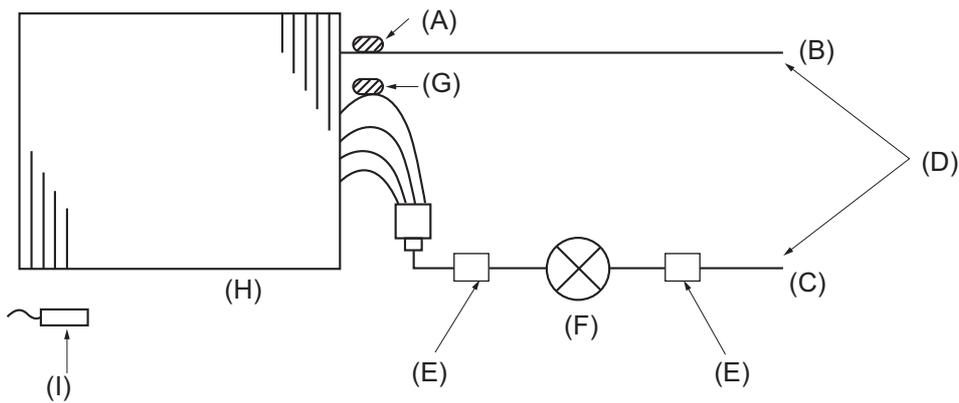

- (A) Gas pipe thermistor TH23
- (B) Gas pipe
- (C) Liquid pipe
- (D) Brazed connections
- (E) Strainer (#100 mesh)
- (F) Linear expansion valve
- (G) Liquid pipe thermistor TH22
- (H) Heat exchanger
- (I) Room temperature thermistor TH21


Capacity	PEFY-MS40, 50VMHS-A	PEFY-MS63, 71, 80VMHS-A	PEFY-MS100, 125, 140VMHS-A
Gas pipe	ø12.7 [1/2]	ø15.88 [5/8]	
Liquid pipe	ø6.35 [1/4]	ø6.35 [1/4]*1 or ø9.52 [3/8]	ø9.52 [3/8]

*1 It is possible to reduce the pipe size to ø6.35 using a "Reducer" included in the accessory bag. The pipe size required depends on the connected outdoor unit, so check the Outdoor Unit Installation Manual to confirm whether the Reducer can be used.

[1] Wiring for interlock between the refrigerant leak sensor output and local equipment

Using the external output of the air conditioning system allows the refrigerant leak output function to interlock with local equipment such as dampers.

For the interlock with local equipment, consider the wiring referring to the following.

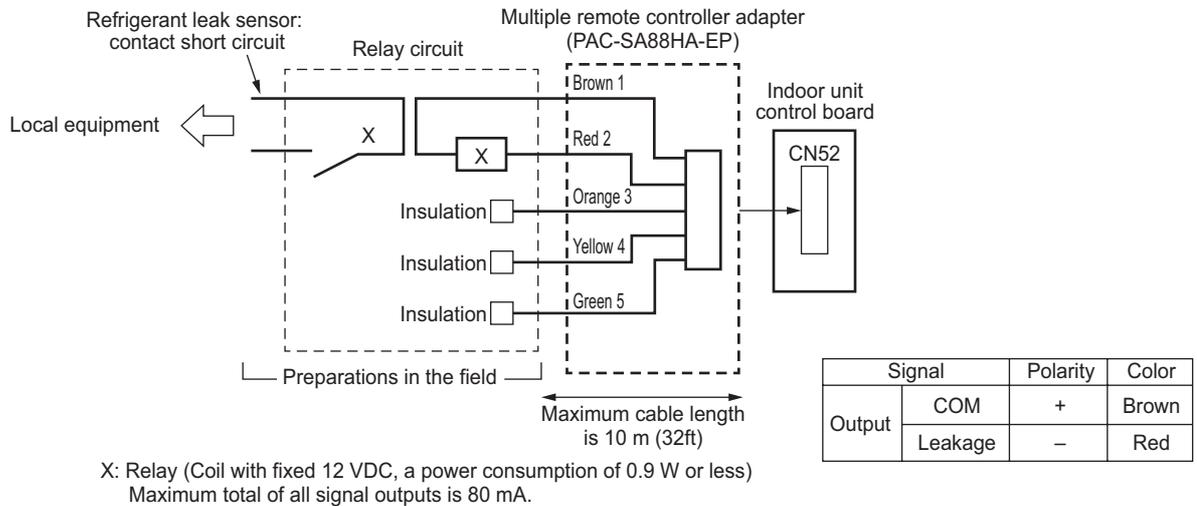

When using the leak output function of CN52, set function setting No. 168 to "5."

Function setting No. 168	Remote display switch	Initial setting
1	Disabled	○
5	A signal will be output when a refrigerant leak is detected or the leak sensor fails.	

* When the function setting is set to "5," the Thermo-ON signal and the fan output signal that are set by SW1-5 will not be output from CN52.

* When setting function setting No. 168 to "5," check that No.169 is set to "1."

[1] Troubleshooting

1. Countermeasures for error during test run

If a problem occurs during test run, a code number will appear on the controller (or LED on the outdoor unit), and the air conditioning system will automatically cease operating.

Refer to the connected outdoor unit service manual in order to determine the nature of the abnormality and apply corrective measure.

Error code	Trouble	Detected Unit			Remarks
		Indoor	Shut off valve kit / Power Supply Interface for Alarm Kit	Remote Controller	
0910	Circuit inspection (Own unit)	○			
0911	Circuit inspection (Other unit)	○	○		
0912	Circuit inspection (Alarm kit)		○		
1521	Refrigerant leakage (Own unit)	○			
1522	Refrigerant leakage (Other unit)	○	○		
1524	Refrigerant leakage (Sensor and Alarm Kit)		○		
2500	Water leakage	○			
2502	Drain overflow protection	○			
2503	Drain sensor abnormality	○			
4114	Fan motor error	○			
5101	Air inlet thermistor (TH21) open/short	○			
5102	Liquid pipe temperature thermistor (TH22) open/short	○			
5103	Gas pipe temperature thermistor (TH23) open/short	○			
5558	Refrigerant sensor error	○			
5701	Contact failure of drain float switch	○			
6600	Duplex address error	○		○	Only M-NET Remote controller is detected.
6602	Transmission processor hardware error	○		○	Only M-NET Remote controller is detected.
6603	Transmission bus BUSY error	○		○	Only M-NET Remote controller is detected.
6606	Signal communication error with transmission processor	○		○	Only M-NET Remote controller is detected.
6607	No ACK error	○		○	Only M-NET Remote controller is detected. *
6608	No response frame error	○		○	Only M-NET Remote controller is detected. *
6815	MA sub remote controller communication error	○			
6831	MA communication receive error (no receive signal)	○		○	Only MA Remote controller is detected.
6832	MA communication send error	○		○	Only MA Remote controller is detected.
6833	MA communication send error	○		○	Only MA Remote controller is detected.
6834	MA communication receive error	○		○	Only MA Remote controller is detected.
7101	Capacity code error	○			
7111	Remote controller sensor fault	○			
7119	Connection error of M-NET line (origin)	○			
7120	Connection error of M-NET line (not origin)	○	○		
7121	Power supply failure	○	○		
7124	Installation error with refrigerant sensor	○			

Note:

When the outdoor unit detects No ACK error/No response error, an object indoor unit is treated as a stop, and not assumed to be abnormal.

* Abnormality for PWFY series

2. Check methods

1. Component and check points

(1) Thermistor

- Room temperature thermistor (TH21)
- Liquid pipe thermistor (TH22)
- Gas pipe thermistor (TH23)

Disconnect the connector and measure the resistance between terminals with a tester.
(Ambient temperature 10°C - 30°C)

Normal	Abnormal
4.3kΩ - 9.6kΩ	Open or short

(Refer to the thermistor characteristic graph below.)

1) Thermistor characteristic graph

Low-temperature thermistor

- Room temperature thermistor (TH21)
- Liquid pipe thermistor (TH22)
- Gas pipe thermistor (TH23)
- Drain sensor (DS)


- Thermistor $R_0 = 15\text{ k}\Omega \pm 3\%$
- Multiplier of B = $3480\text{ k}\Omega \pm 2\%$

$$R_t = 15 \exp \left\{ 3480 \left(\frac{1}{273+t} - \frac{1}{273} \right) \right\}$$

- 0°C 15kΩ
- 10°C 9.6kΩ
- 20°C 6.3kΩ
- 25°C 5.2kΩ
- 30°C 4.3kΩ
- 40°C 3.0kΩ

(A) Temperature (°C)

(B) Resistance (kΩ)

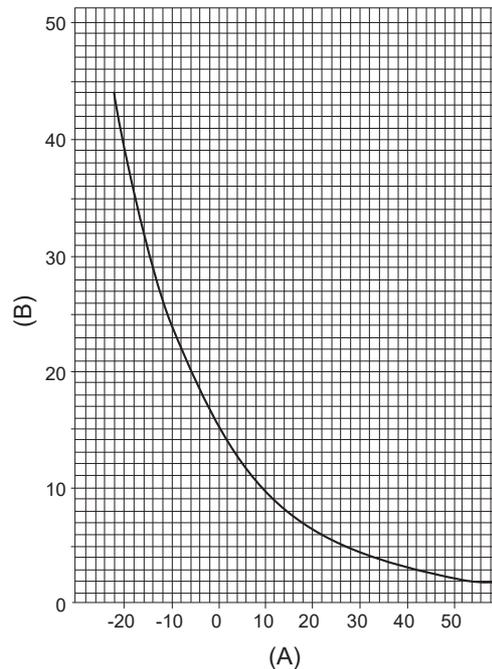

(2) Fan motor (CNMF1)

Refer to the page on "DC fan motor (fan motor/indoor control board)."

(3) Linear expansion valve

Disconnect the connector, and measure the resistance between terminals with a tester.
Refer to the next page for details.


	Normal				Abnormal
	1-6 White-Red	2-6 Yellow-Red	3-6 Orange-Red	4-6 Blue-Red	Open or short
	(150Ω) ±10%				

- (A) Red
- (B) Orange
- (C) Blue
- (D) Orange
- (E) Yellow
- (F) White

1) Summary of linear expansion valve (LEV) operation

- The LEV is operated by a stepping motor, which operates by receiving a pulse signal from the indoor control board.
- The LEV position changes in response to the pulse signal.

Indoor control board and LEV connection

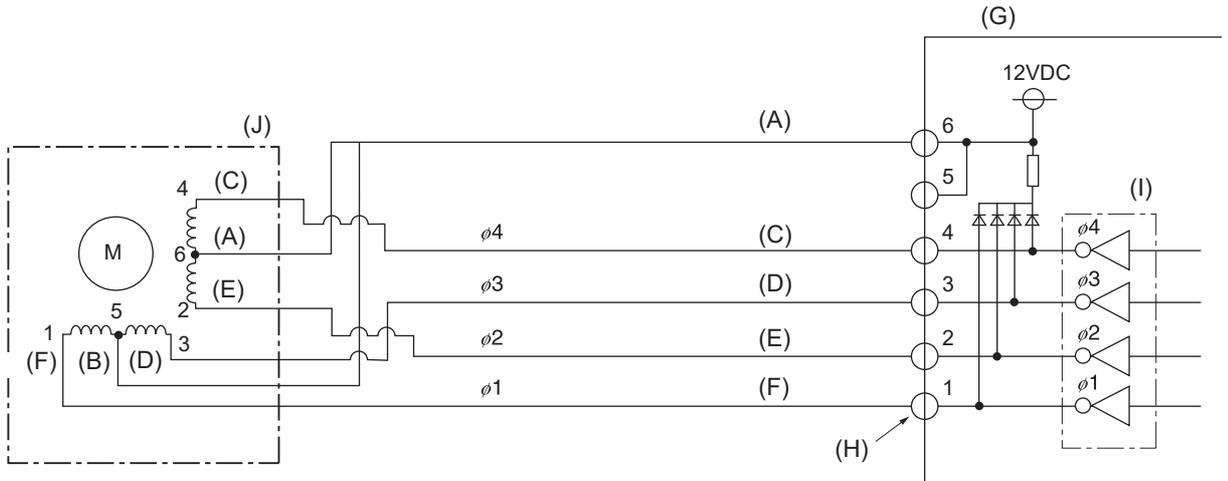

- (A) Red
- (C) Blue
- (D) Orange
- (E) Yellow
- (F) White
- (G) Control board
- (H) Connection (CN60)
- (I) Drive circuit
- (J) Linear expansion valve

Pulse signal output and valve operation

Phase number	Output pulse			
	1	2	3	4
ø1	ON	OFF	OFF	ON
ø2	ON	ON	OFF	OFF
ø3	OFF	ON	ON	OFF
ø4	OFF	OFF	ON	ON


The output pulse changes in the following order:

When the valve closes 1 -> 2 -> 3 -> 4 -> 1

When the valve opens 4 -> 3 -> 2 -> 1 -> 4

- When the valve position remains the same, all output signals will be OFF.
- If any output signal is missing or if the signal remains ON, the motor vibrates and makes clicking noise.

2) LEV operation

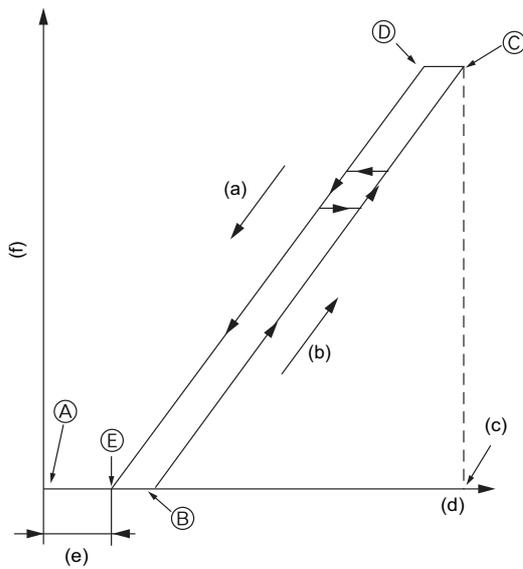


- (a) Close
- (b) Open
- (c) Fully open valve (2000 pulses)
- (d) No. of pulses
- (e) Extra tightening (200 pulses)
- (f) Valve opening degree


- When the power is turned on, a pulse signal of fully open pulse + 10% pulse is output (valve closure signal), to bring the valve to position A.
- When the valve is operating normally, it is free of vibration noise. If the valve locks or when it goes from point E to A in the figure, it makes louder noise than would be heard when there is an open phase.
- Check for abnormal sound/vibration by placing the metal tip of a screwdriver against the valve and the handle side against your ear.

3) Troubleshooting

Symptom	Checking Criteria	Remedy
Circuit failure on the microcomputer	Disconnect the connectors on the control board, and connect LEDs to test the circuit as shown below. Pulse signals are output for 10 seconds when the main power is turned on. If there are LEDs that do not light up at all or remain lit after the pulses are turned off, there is a problem with the driving circuit.	Replace the indoor control board if driving circuit failure is detected.
Locked LEV	The motor will idle and make small clicking noise if it is run while the LEV is locked. If this clicking noise is heard both when the valve is fully closed and while it is being opened, it indicates a problem.	Replace the LEV.
Disconnected or shorted LEV motor coils	Measure the resistance between the coils with a tester (red-white, red-orange, Red-yellow, Red-blue). The normal range of resistance is $150\Omega \pm 10\%$	Replace the LEV.

<p>Valve closure failure (leaky valve)</p>	<p>To check the LEV on the indoor unit, check the indoor unit liquid pipe temperature that appears on the operation monitor on the outdoor unit's multi control board while operating the indoor unit in question in the FAN mode and the other indoor units in the cooling mode.</p> <p>(A) Thermistor (TH22)</p>  <p>Normally, the LEV is fully closed while the unit is in the FAN mode. If the valve is leaky, liquid pipe thermistor reading will be lower than normal. If it is significantly lower than the inlet temperature on the remote controller, valve closure failure is suspected. If the amount of leakage is insignificant, replacement of LEV is unnecessary unless it is causing a problem.</p>	<p>Replace the LEV if the amount of leakage is great.</p>
<p>Misconnections of connectors or contact failure</p>	<p>Perform a visual check for disconnected connectors. Perform a visual check of lead wire color.</p>	<p>Disconnect the connectors on the control board and perform a continuity test.</p>

(4) Drain pump



1. Check if the drain float switch works properly.
2. Check if the drain pump works and drains water properly in cooling operation.
3. If no water drains, confirm that the check code 2502 will not be displayed 10 minutes after the operation starts.

Note: The drain pump for this model is driven by the internal DC motor of controller board, so it is not possible to measure the resistance between the terminals.


Normal

Red-Black: Input 13V DC → The fan starts to rotate.

Purple-Black: Abnormal (check code 2502) if it outputs 0-13 V square wave (5 pulses/rotation), and the number of rotation is not normal.

(5) Drain float switch (CN4F)

Disconnect the connector, and measure the resistance between terminals with a tester.

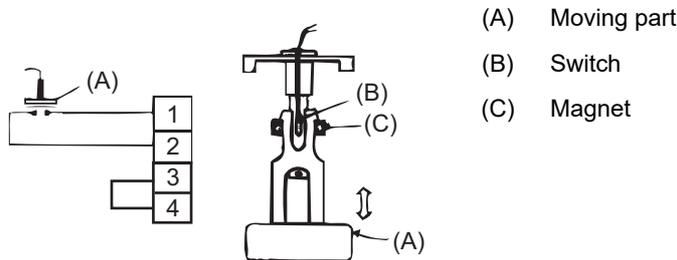

Position of the moving part	Normal	Abnormal
Up	Short	(any position but short)
Down	Open	(any position but open)


(6) Refrigerant sensor

Measure the resistance between the terminals with a multimeter.

Normal	Abnormal
Below 10 Ω	Open (10 Ω or more)

After turning off the indoor unit breaker and leaving it for 5 minutes, measure the resistance value between the sensor terminals.

< Back side of the sensor >



Measure the both sides of the sensor pin.

1) Troubleshooting

Error Code	Abnormal point and detection method	Cause	Countermeasure
5558	Refrigerant sensor error Abnormal if refrigerant sensor cannot detect errors normally.	1. The refrigerant sensor mounted on the indoor unit does not work. 2. The refrigerant sensor is not connected properly or the wire is broken.	Refer to the outdoor unit manual. ♦While the error is being displayed, the indoor unit fan continues operating. * The circulation operation is performed when the EN 378-compliant setting is enabled and error code 5558 is displayed.
1521	Refrigerant leakage Abnormal if refrigerant leakage is detected by a refrigerant sensor.	1. Refrigerant leaks from the piping or the heat exchanger in the indoor unit. 2. The following items are used around the indoor unit. ♦Spray (LP gas including Freon, and whose main ingredient is propane and butane) ♦Aerosol insecticide (including ethanol) ♦Air spray painting (including dichloromethane) ♦Charcoal (charcoal fire) ♦Chemicals (such as ethanol)	♦Ventilate the room well, make sure that there is no ignition source, and then turn off the power.
1522	Refrigerant leakage / Communication error	♦Refrigerant leak from the air conditioner or the piping ♦False detection (The refrigerant sensor reacted to other gas.) ♦There is an abnormality in the communication line or communication system.	Refer to the outdoor unit manual. ♦Ventilate the room well, make sure that there is no ignition source, and then turn off the power.


3. DC fan motor (fan motor/indoor control board)

1. CAUTION

- A high voltage is applied to the connector for connection to the fan motor (CNMF1).
- Do not unplug the connector CNMF1 with the unit energized to avoid damage to the indoor control board and fan motor.


2. Troubleshooting

- Symptom: Indoor unit fan does not run.

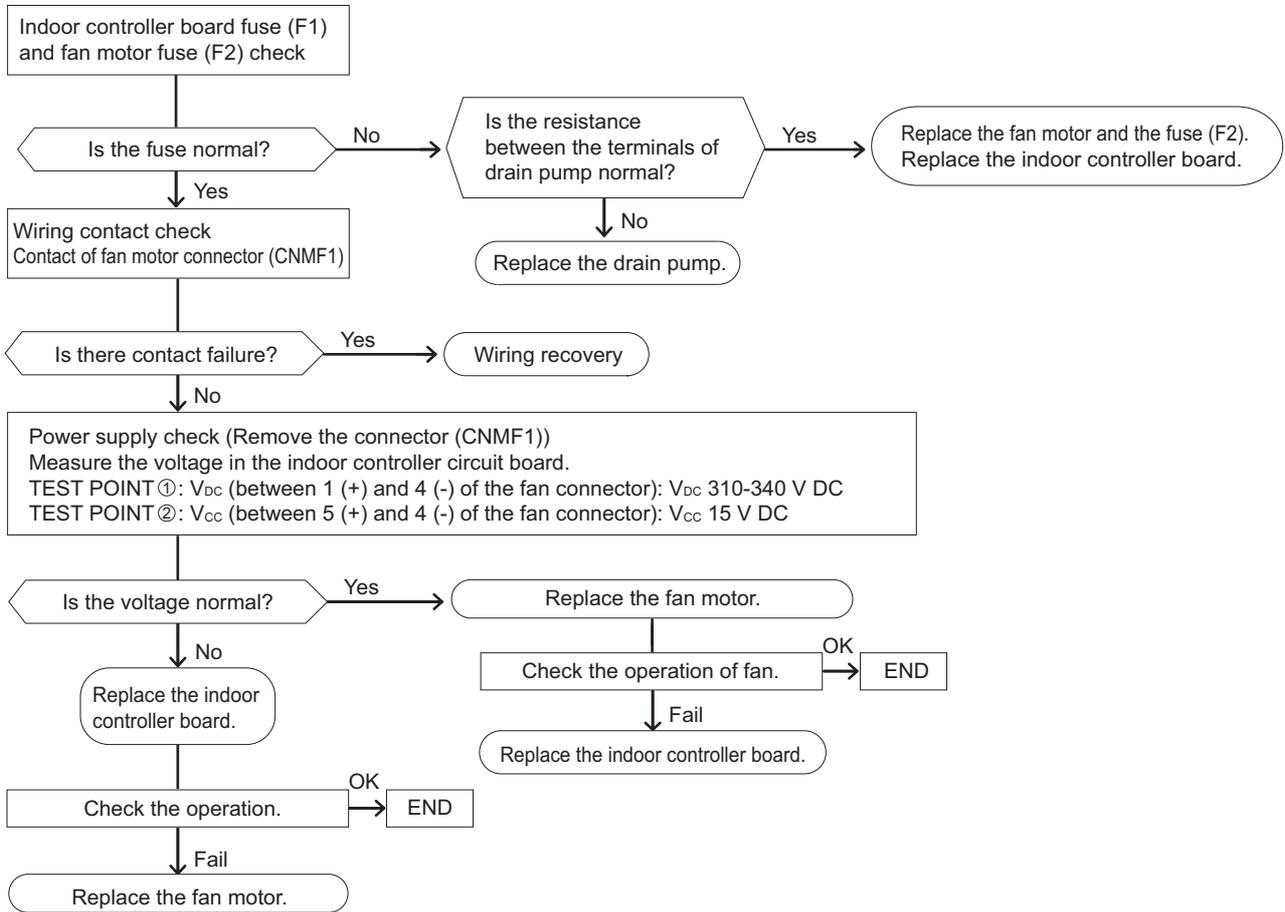

4. Address switch setting

Make sure that power to the unit is turned off.

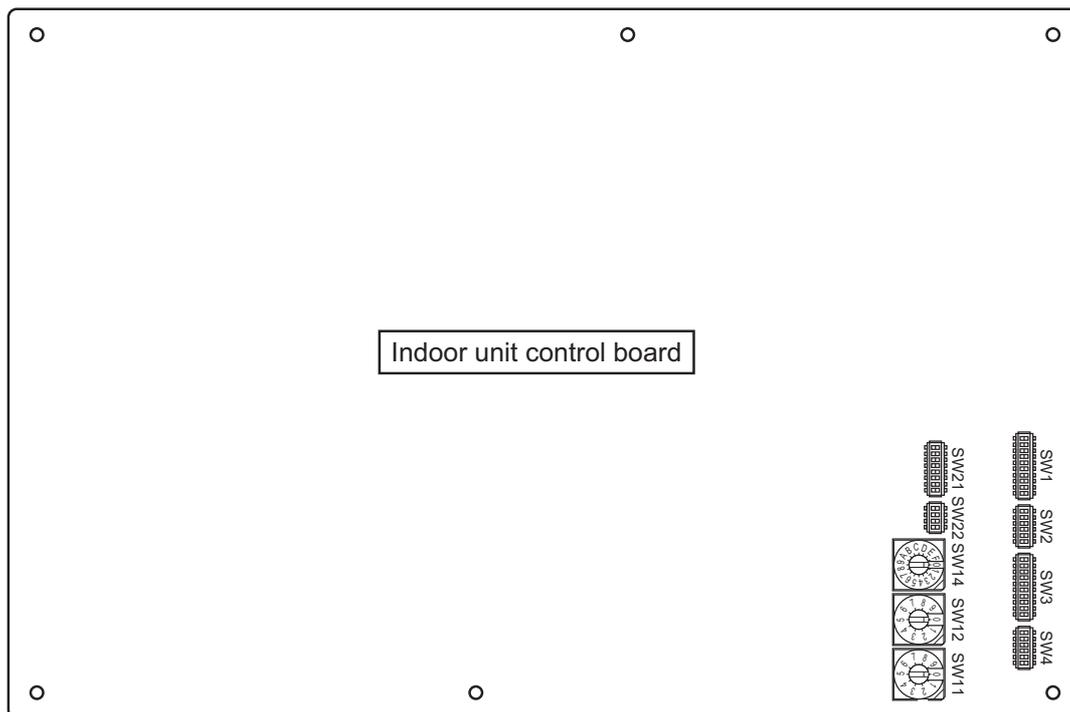

1. When using an ME remote controller, set the address with the rotary switches (SW11, SW12).

•Address setting is not required when the unit remote controller is used.


On-site address setting is required for the indoor units to run.

* ME remote controllers cannot be connected to R32 refrigerant systems.

2. Address settings vary in different systems.
Refer to the section on address setting in the outdoor unit installation manual.
3. Address is set with a combination of SW12 (10's digit) and SW11 (1's digit).
To set the address to "3," set SW12 to "0" and SW11 to "3."
To set the address to "25," set SW 12 to "2" and SW 11 to "5."

5. Voltage test points on the control board

1. PEFY-MS40, 50, 63, 71, 80, 100, 125, 140VMHS-A

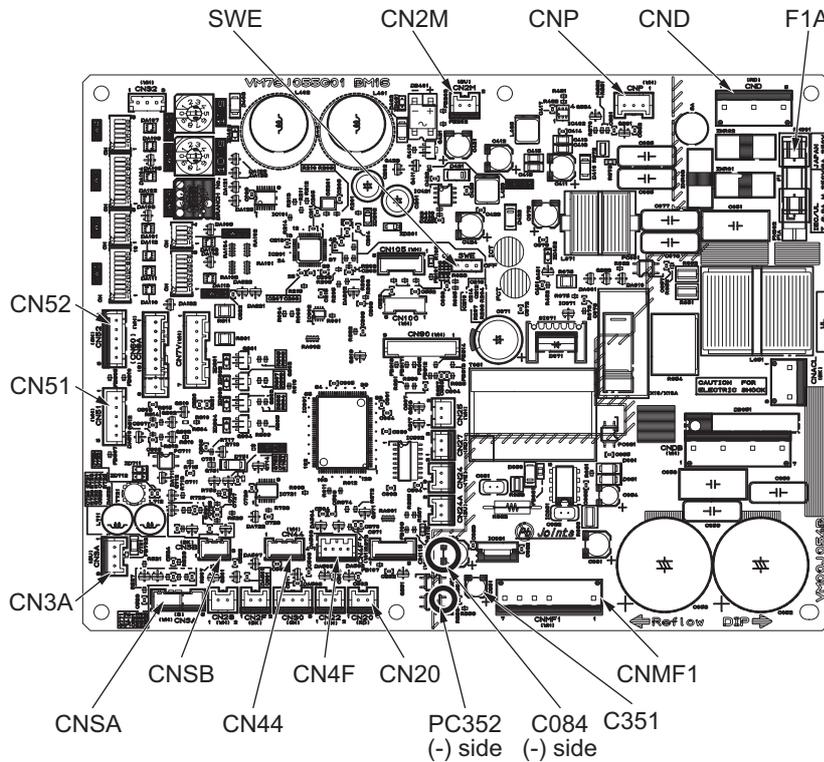

- F1 Fuse (AC 250V 6.3A)
- CND Power supply voltage (220 - 240VAC)
- CN2M For M-NET transmission cable connection (24 - 30VDC)
- SWE Emergency operation
- SW2 Capacity setting
- SW3 Function setting
- SW4 Function setting
- CN32 Remote start/stop adapter
- CN3A For MA remote controller cable connection (10 - 13 VDC (Between 1 and 3.))
- CNSA Refrigerant sensor
- CNSB Refrigerant sensor enable/disable switch
- CN52 Remote display
- CN51 Centralized control
- CN41 JAMA standard HA terminal A
- CN44 Thermistor (liquid/gas temperature)
- CN4F Float switch
- CN20 Thermistor (Inlet temperature)
- CNMF1 Fan motor output
 1 - 4: 310 - 340 VDC
 5 - 4: 15 VDC
 6 - 4: 0 - 6.5 VDC
 7 - 4: Stop 0 or 15 VDC
 Run 7.5 VDC
 (0 - 15 pulse)

(*1)

- V_{FG} Voltage on the (-) side of PC352 and C084 (Same with the voltage between 7 (+) and 4 (-) of CNMF1)
- V_{CC} Voltage between the C084 pins 15 VDC (Same with the voltage between 5 (+) and 4 (-) of CNMF1)
- V_{sp} Voltage between the C351 pins 0VDC (with the fan stopped)
 1 - 6.5VDC (with the fan in operation)
 (Same with the voltage between 6 (+) and 4 (-) of CNMF1)


6. Setting (Factory setting)

1. Function setting

(1) SW1

Switch position	Function	Switch setting	
		ON	OFF
1	Active Thermistor (Intake air thermistor)	Built-in thermistor on the remote controller	Indoor unit
2	Filter clogging detection	Available	Unavailable
3	Filter life	2500 hr	100 hr
4	Outdoor air intake	Enabled	Disabled
5	Remote display	Thermo-ON signal	Fan output
6	-	-	-
7	Fan speed	Low	Very low
8	Fan speed at heating Thermo-OFF	Preset fan speed	Follows the setting of SW1-7
9	Auto restart after power failure	Enabled	Disabled
10	Power start/stop	Enabled	Disabled

Factory setting




(2) SW3

Switch position	Function	Switch setting	
		ON	OFF
1	Unit type	Cooling only	Heat pump
2	-	-	-
3	-	-	-
4	-	-	-
5	-	-	-
6	-	-	-
7	-	-	-
8	Heating 4-deg up	Disabled	Enabled
9	-	-	-
10	-	-	-


Dipswitch settings must be made while the unit is stopped.

Factory setting



PEFY-MS40, 100VMHS-A



PEFY-MS71, 80, 125VMHS-A



PEFY-MS50, 63, 140VMHS-A



The figure at left shows that the switches 1 through 5 are set to ON and 6 through 10 are set to OFF.

2. Capacity code setting


(1) SW2

Dipswitch settings must be made while the unit is stopped.


Factory setting

The switches are set to correspond to the unit capacity.


PEFY-MS40VMHS-A




PEFY-MS50VMHS-A




PEFY-MS63VMHS-A




PEFY-MS71VMHS-A




PEFY-MS80VMHS-A





PEFY-MS100VMHS-A



PEFY-MS125VMHS-A



PEFY-MS140VMHS-A



The figure at left shows that the switches 1 through 5 are set to ON and 6 through 10 are set to OFF.

3. Model setting

(1) SW4

Dipswitch settings must be made while the unit is stopped.

Factory setting

Please see the WIRING LABEL on the control box.

Note:

Changes made to the dipswitches SW1, SW2, and SW3 will become effective when the unit comes to a stop (remote controller off). There is no need to power cycle the unit.

4. Power voltage setting

(1) SW21-6

Dipswitch settings must be operated with the main power turned OFF.

Factory setting

Please see the WIRING LABEL on the control box.

Set SW21-6 to OFF side when the power supply is 240 volts.

When the power supply is 220 and 230 volts, set SW21-6 to ON side.

5. External static pressure

Five levels of external static pressure are available for selection.

Set the setting either by using the switches on the control board (SW21-1, SW21-2, and SW21-5) or from the function selection screen on the remote controller.

Note:

◆When the static pressure setting was set from the remote controller, the actual setting and the switch setting on the control board may not match because the latest setting from the remote controller overrides the previous setting. To check the latest static pressure setting, check it on the remote controller, not on the switch.

◆If the static pressure setting for the duct is lower than that for the unit, the fan of the unit may repeat start/stop, and the outdoor unit may remain in a stopped state. Match the static pressure settings for the unit to that for the duct.

To set the external static pressure with the switches on the control board

External static pressure	SW21-1	SW21-2	SW21-5	Initial setting
50 Pa	ON	OFF	OFF	○
100 Pa	OFF	ON	ON	
150 Pa	OFF	OFF	ON	
200 Pa	ON	OFF	ON	

To set the external static pressure from the function selection screen on the remote controller (PAR-42MAAB)

Follow the instructions below and the instructions detailed in the remote controller manual for how to set the switches.

- Set the function setting No. 32 (Switch setting/Function selection) to "2".
 - Set the function setting No. 8 and No. 10 to appropriate values, according to the external static pressure.
- * Even if the setting value for function setting No. 32 is changed to "2" on the remote controller after selecting the external static pressure with control board switch, the setting made with the control board switch will remain in effect until function setting No. 8,10 is configured.
- * If the setting value for function setting No. 32 is changed to "1", the setting made with the control board switch will apply.

Selection	Function setting No.	Current setting
	No. 32	
Switch setting	1	
Function selection	2	

External static pressure	Function setting No.		Initial setting	Current setting
	No. 8	No. 10		
50 Pa	3	1	○	
100 Pa	1	2		
150 Pa	2	2		
200 Pa	3	2		

[Important]
Be sure to write down the settings for all functions in the "Current setting" row if any of the initial settings has been changed.


6. 1s and 10ths digits

- (1) SW11, SW12 (Rotary switch)

The use of an ME remote controller requires address setting.

Address settings must be made while the unit is stopped.

Factory setting



7. Connection No. setting

- (1) SW14 (Rotary switch)

This switch is used when the unit connected to an R2 series of outdoor unit.

Factory setting



Note:

Changes to the dipswitches SW11, SW12, SW14, and SW15 must be made while the unit is stopped and the remote controller is OFF.

8. CNSB

•**CNSB short circuit connector (enables/disables settings for the refrigerant sensor)**

It is to enable/disable the refrigerant sensor mounted to the indoor unit. If the indoor unit is installed in a large space or the sensor and alarm kit is used, remove the short-circuit connector. For details, refer to the R32 City Multi Technical Manual (R32 Outdoor unit).

Short circuit connector	Built-in refrigerant sensor on the indoor unit	Initial setting
Connected	Enabled	○
Disconnected	Disabled	

[1] Disassembly Procedure

1. Control box

Exercise caution when removing heavy parts.

1. Removing the control box cover

- (1) Remove the three fixing screws on the cover (A) to remove it.

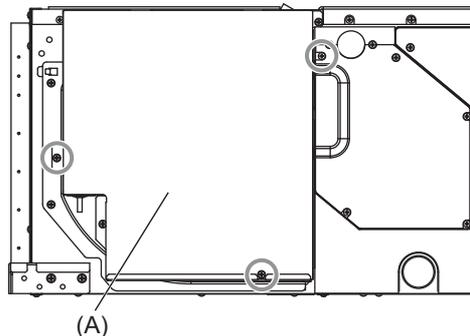


Fig.1

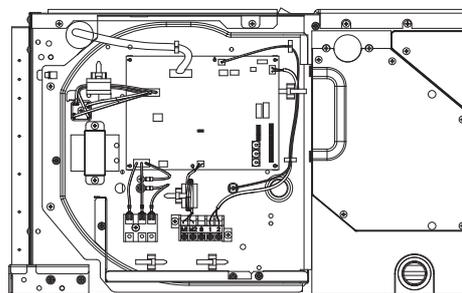


Fig.2 For MS40/50/63 models

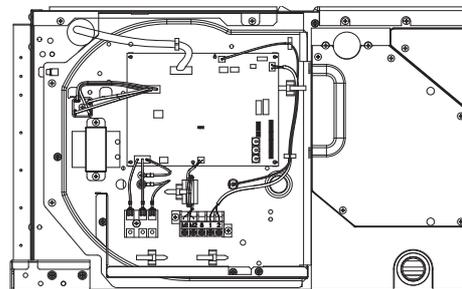


Fig.3 For MS71/80 models

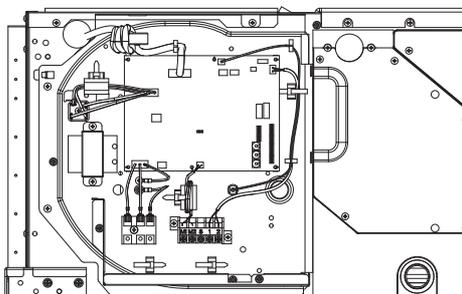


Fig.4 For MS100/125/140 models

2. Thermistor (Intake air)

Exercise caution when removing heavy parts.

1. Remove the control box cover according to the procedure in section 1.
2. Remove the thermistor.
 - (1) Disconnect the connector (CN20) from the indoor control board.
 - (2) Pull out the thermistor holder (B) and thermistor (C) on the control box.

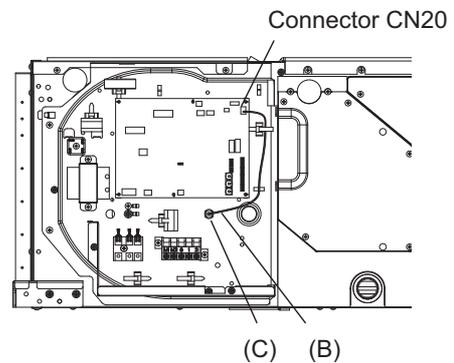


Fig.5

3. LEV, thermistor (Liquid/Gas piping temperature detection)

Exercise caution when removing heavy parts.

1. Remove the LEV.
 - (1) Remove the control box cover according to the procedure in section 1.
 - (2) Remove the five fixing screws on the heat exchanger cover (D) to remove it.
 - (3) Disconnect the connector (CN60) from the indoor control board.
 - (4) Remove the LEV driving motor (E).
 - (5) Pull out the LEV lead wiring from the unit.

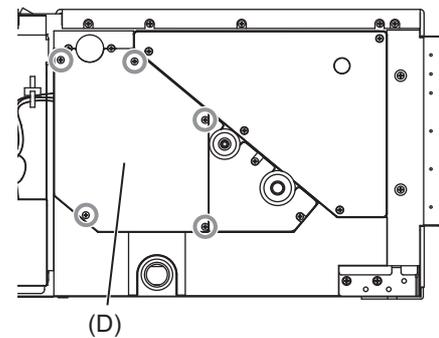


Fig.6

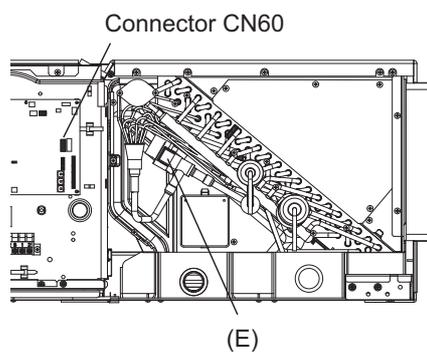


Fig.7

2. Remove the thermistors.
 - (1) Disconnect the connector (CN44) from the indoor control board.
 - (2) Pull out each thermistor (F) from its holder which is installed on the pipe (gas/liquid).
 - (3) Remove the thermistor lead wiring from the unit.

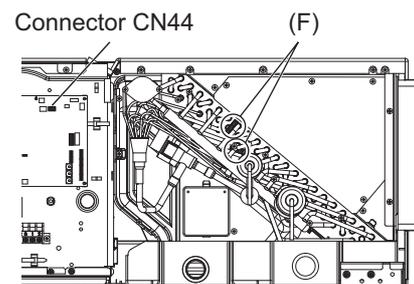


Fig.8

4. Drain pan

Exercise caution when removing heavy parts.

1. Remove the heat exchanger cover according to the procedure in section 3.1.(2).
2. Removing the bottom plate.
 - (1) Remove the twelve fixing screws on the bottom plate (G) to remove it.

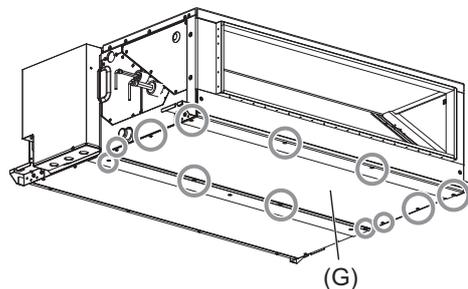


Fig.9

3. Removing the drain pan.
 - (1) Pull out the drain pan (H) in the direction of the arrow.

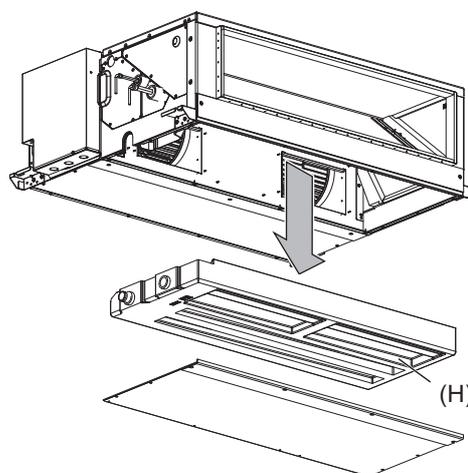


Fig.10

Note
•Drain the water out of the drain pan before removing it.

5. Heat exchanger

Exercise caution when removing heavy parts.

1. Remove the control box cover according to the procedure in section 1.
2. Remove the heat exchanger cover according to the procedure in section 3.1.(2).
3. Disconnect the thermistor connector according to the procedure in section 3.2.
4. Removing the drain pan according to the procedure in section 4.
5. Removing the heat exchanger.
(1) Remove the four fixing screws on the cover (I, J) to remove it.

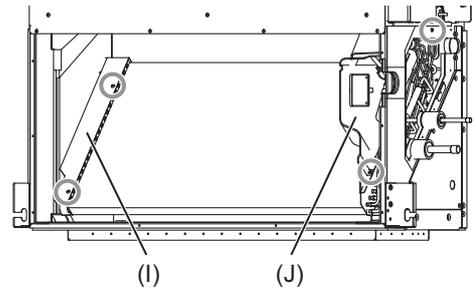


Fig.11

- (2) Remove the four fixing screws on the maintenance cover (K) to remove it.

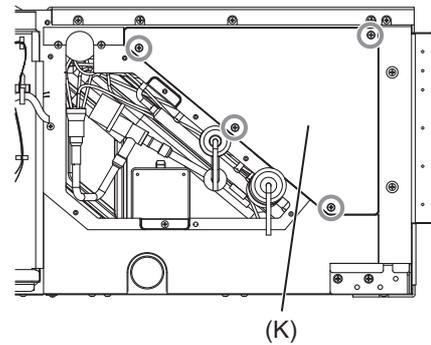


Fig.12

- (3) Remove the four fixing screws on the heat exchanger (L) to remove it.

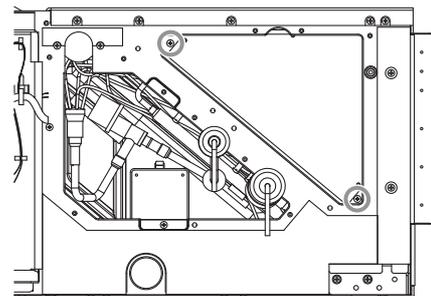


Fig.13

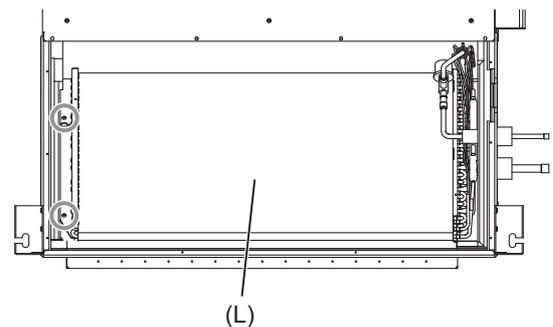


Fig.14

6. Fan and fan motor

Exercise caution when removing heavy parts.

1. Remove the control box cover according to the procedure in section 1.
2. Removing the fan motor cable.
 - (1) Disconnect the fan motor connector (CNMF1) from the control board.
*For MS100/125/140 models
Remove the ferrite core (M) from the fan motor cable.
 - (2) Remove the cable through the rubber bush.

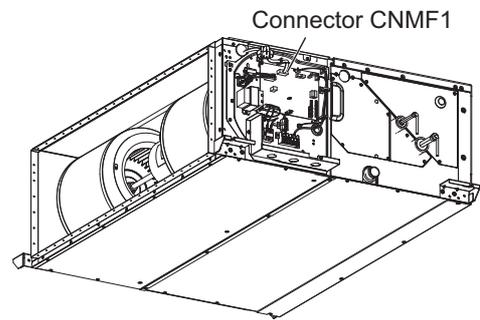


Fig.15

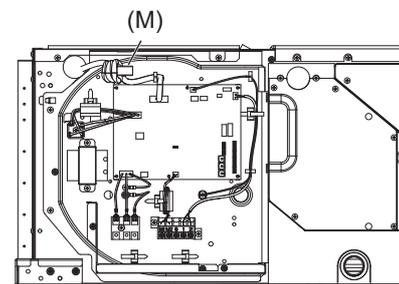


Fig.16

3. Removing the bottom plate.
 - (1) Remove the fifteen fixing screws on the bottom plate (N) to remove it.

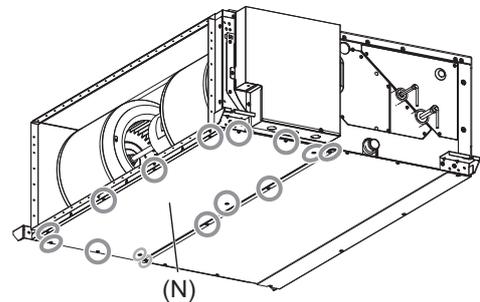


Fig.17

4. Removing the fan case.
 - (1) Remove the eight fixing screws on the fan case to remove it.

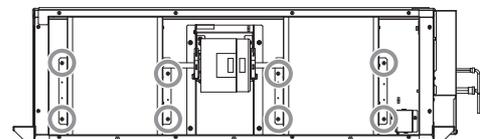


Fig.18

5. Removing the fan and fan motor.

- (1) Remove the earth lead of motor from the motor base
The grounding wire of the motor wire is only for the MS100/125/140 models.

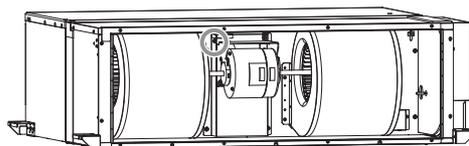


Fig.19

- (2) Remove the two fixing screws and attachment on the fan motor.
- (3) Pull out the fan motor in the direction of the arrow.

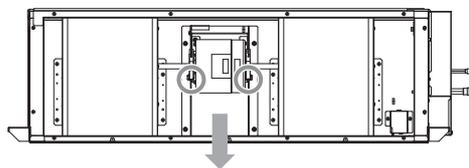


Fig.20

7. R32 sensor

Exercise caution when removing heavy parts.

1. Remove the control box cover according to the procedure in section 1.
2. Remove the R32 sensor.
 - (1) Disconnect the connectors listed below from the indoor control board.
 - CNSA (R32 sensor)
 - CN44 (Heat exchanger thermistor)
 - CN60 (LEV)
 - CNMF1 (motor)
 - (2) Remove the two fixing screws (P) on the control box sheet metal (Q) to remove it.
 - (3) Remove the two fixing screws (R) on the sensor cover (S) to remove R32 sensor.

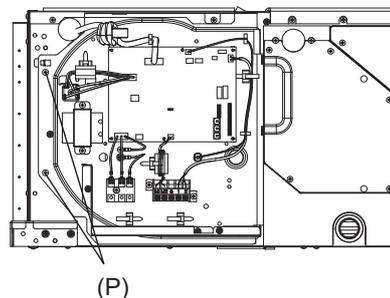


Fig.21

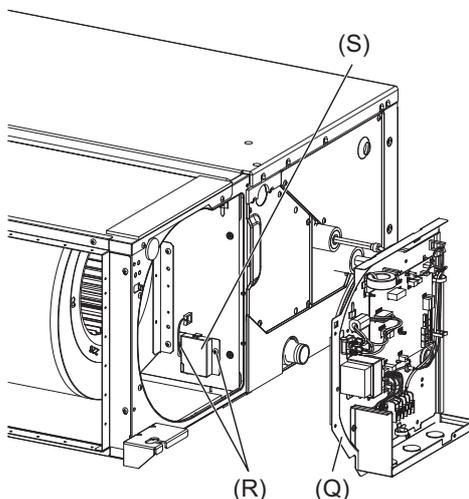


Fig.22

[1] Inspection and maintenance

1. Guideline for preventive maintenance

The following maintenance intervals indicate the estimated intervals of parts replacement and repair to be required as a result of periodic inspections. They do not necessarily mean that replacement is required at the maintenance intervals. The maintenance intervals do not indicate the warranty period.

Parts	Inspection interval	Maintenance interval*
Motor (Fan, drain pump)	1 year	20,000 hours
Bearing		15,000 hours
Electrical box		25,000 hours
Heat exchanger		5 years
Electronic expansion valve		20,000 hours
Sensor (Thermistor, refrigerant sensor, etc.)		5 years
Drain pan		8 years

- ♦The table above shows the main parts. Check the maintenance contract for details.
- ♦This maintenance interval is an estimated period until the day when the maintenance should be conducted to use the product safely for a long time.
Make use of the table above for maintenance planning (such as planning budget for maintenance inspection cost). Depending on the contents of the maintenance contract, the actual inspection and maintenance intervals may shorter than those in the table above.
- ♦The maintenance and inspection items may differ depending on maintenance providers.
Please check with your maintenance provider when concluding a maintenance contract.

*The following usage conditions are assumed.

- ♦Normal use without frequent START/STOPs (The number of START/STOPs is assumed to be less than 6 times per hour in normal use)
- ♦Operating hours are assumed to be 10 hours per day/2500 hours per year.

When the equipment is used under the following conditions, the maintenance interval may be shortened.

- ♦When equipment is used in an environment where temperature and humidity are high or change dramatically
- ♦When equipment is used in an environment where power supply fluctuations (the distortion of voltage, frequency, and waveform) are large (only within the allowable range)
- ♦When equipment is used in an environment where the equipment may receive vibration or mechanical shock
- ♦When equipment is used in an environment where dust, salt, toxic gases such as sulfur dioxide and hydrogen sulfide, and oil mist are present
- ♦When equipment starts/stops frequently and operates for long periods (24-hour air-conditioning operation)

2. Recommended parts inspection interval

Parts	Inspection interval	Maintenance interval	Inspection items	Criteria	Measures
Long-life filter	1 year	5 years	•Visual check for dirt or torn.	•Filter element is seen through. •No torn or deformation.	•Clean the filter if it is dirty. •Replace the filter if it is torn.
Smoothing capacitor		10 years	•Check the appearance of electrolytic capacitors.	•No liquid leakage, deformation, or sleeve (outer film) shrinkage.	Replace the electrolytic capacitor if there is leakage, deformation, or shrinkage of the sleeve (outer film).
Fuse		10 years	•Check the appearance.	No deformation or discoloration.	•Replace the fuse if the circuit is cut off.
Motor (Fan, drain pump)		20,000 hours	•Auditory check for operating sounds. •Measure the insulation resistance.	•No abnormal sounds. •Insulation resistance must be 1 MΩ or above.	•Replace the fan motor if an insulation problem is found.
Bearing		15,000 hours	•Fill oil periodically.	•No abnormal sound.	•Periodically replace the parts.
Electrical box		25,000 hours	•Check the insulation resistance of the circuit (500 V) •Check for loose terminals and connectors.	•Insulation resistance must be 1 MΩ or above. •No loose connections. •No accumulated foreign objects. •No error display.	•Clean with a brush if dust accumulation is found. •Replace the electrical part if the insulation resistance is 1 MΩ or below. •Tighten the loose terminals and reconnect the connectors.
Heat exchanger		5 years	•Check for clogging, contamination, and damage.	No clogging, contamination, or damage.	Perform cleaning.
Electronic expansion valve		20,000 hours	•Operation check •using operation data.	Temperature must change in proportion to the valve position. (Check the temperature variation with the centralized controller.)	Replace the valve if the operation data show an operation failure due to valve problems.
Sensor (Thermistor, refrigerant sensor, etc.)		5 years	•Check for breakage and deterioration of the cables, and for disconnection of the connectors. •Measure the insulation resistance. •Check the resistance of parts (Thermistor, refrigerant sensor).	•No breakage or deterioration of the cables or disconnected connectors. •Insulation resistance must be 1 MΩ or above. •Please refer to VIII Troubleshooting.	Replace the sensor if the cable is broken, short-circuited, or severely deteriorated, or an insulation problem is found.
Drain pan		8 years	•Check for clogging and drain water flow. •Check for coating's peeling or separation.	•No drain clogging. •No abnormal rust or hole.	•Clean the drain pan and check that the drain pan is tilted properly. •Replace the drain pan depending on the repairing coating or conditions.

- The table above shows the main parts. Check the maintenance contract for details.
- This maintenance interval is an estimated period until the day when the maintenance should be conducted to use the product safely for a long time.
Make use of the table above for maintenance planning (such as planning budget for parts replacement cost).
- The inspection intervals depend on the usage and environment.
The inspection intervals do not indicate the warranty period.
- The maintenance and inspection items may differ depending on maintenance providers. Please check with your maintenance provider when concluding a maintenance contract.
- Repairs outside the warranty period will be charged, even if periodic inspections have been performed at the recommended intervals.

mitsubishi electric corporation

www.MitsubishiElectric.com
